










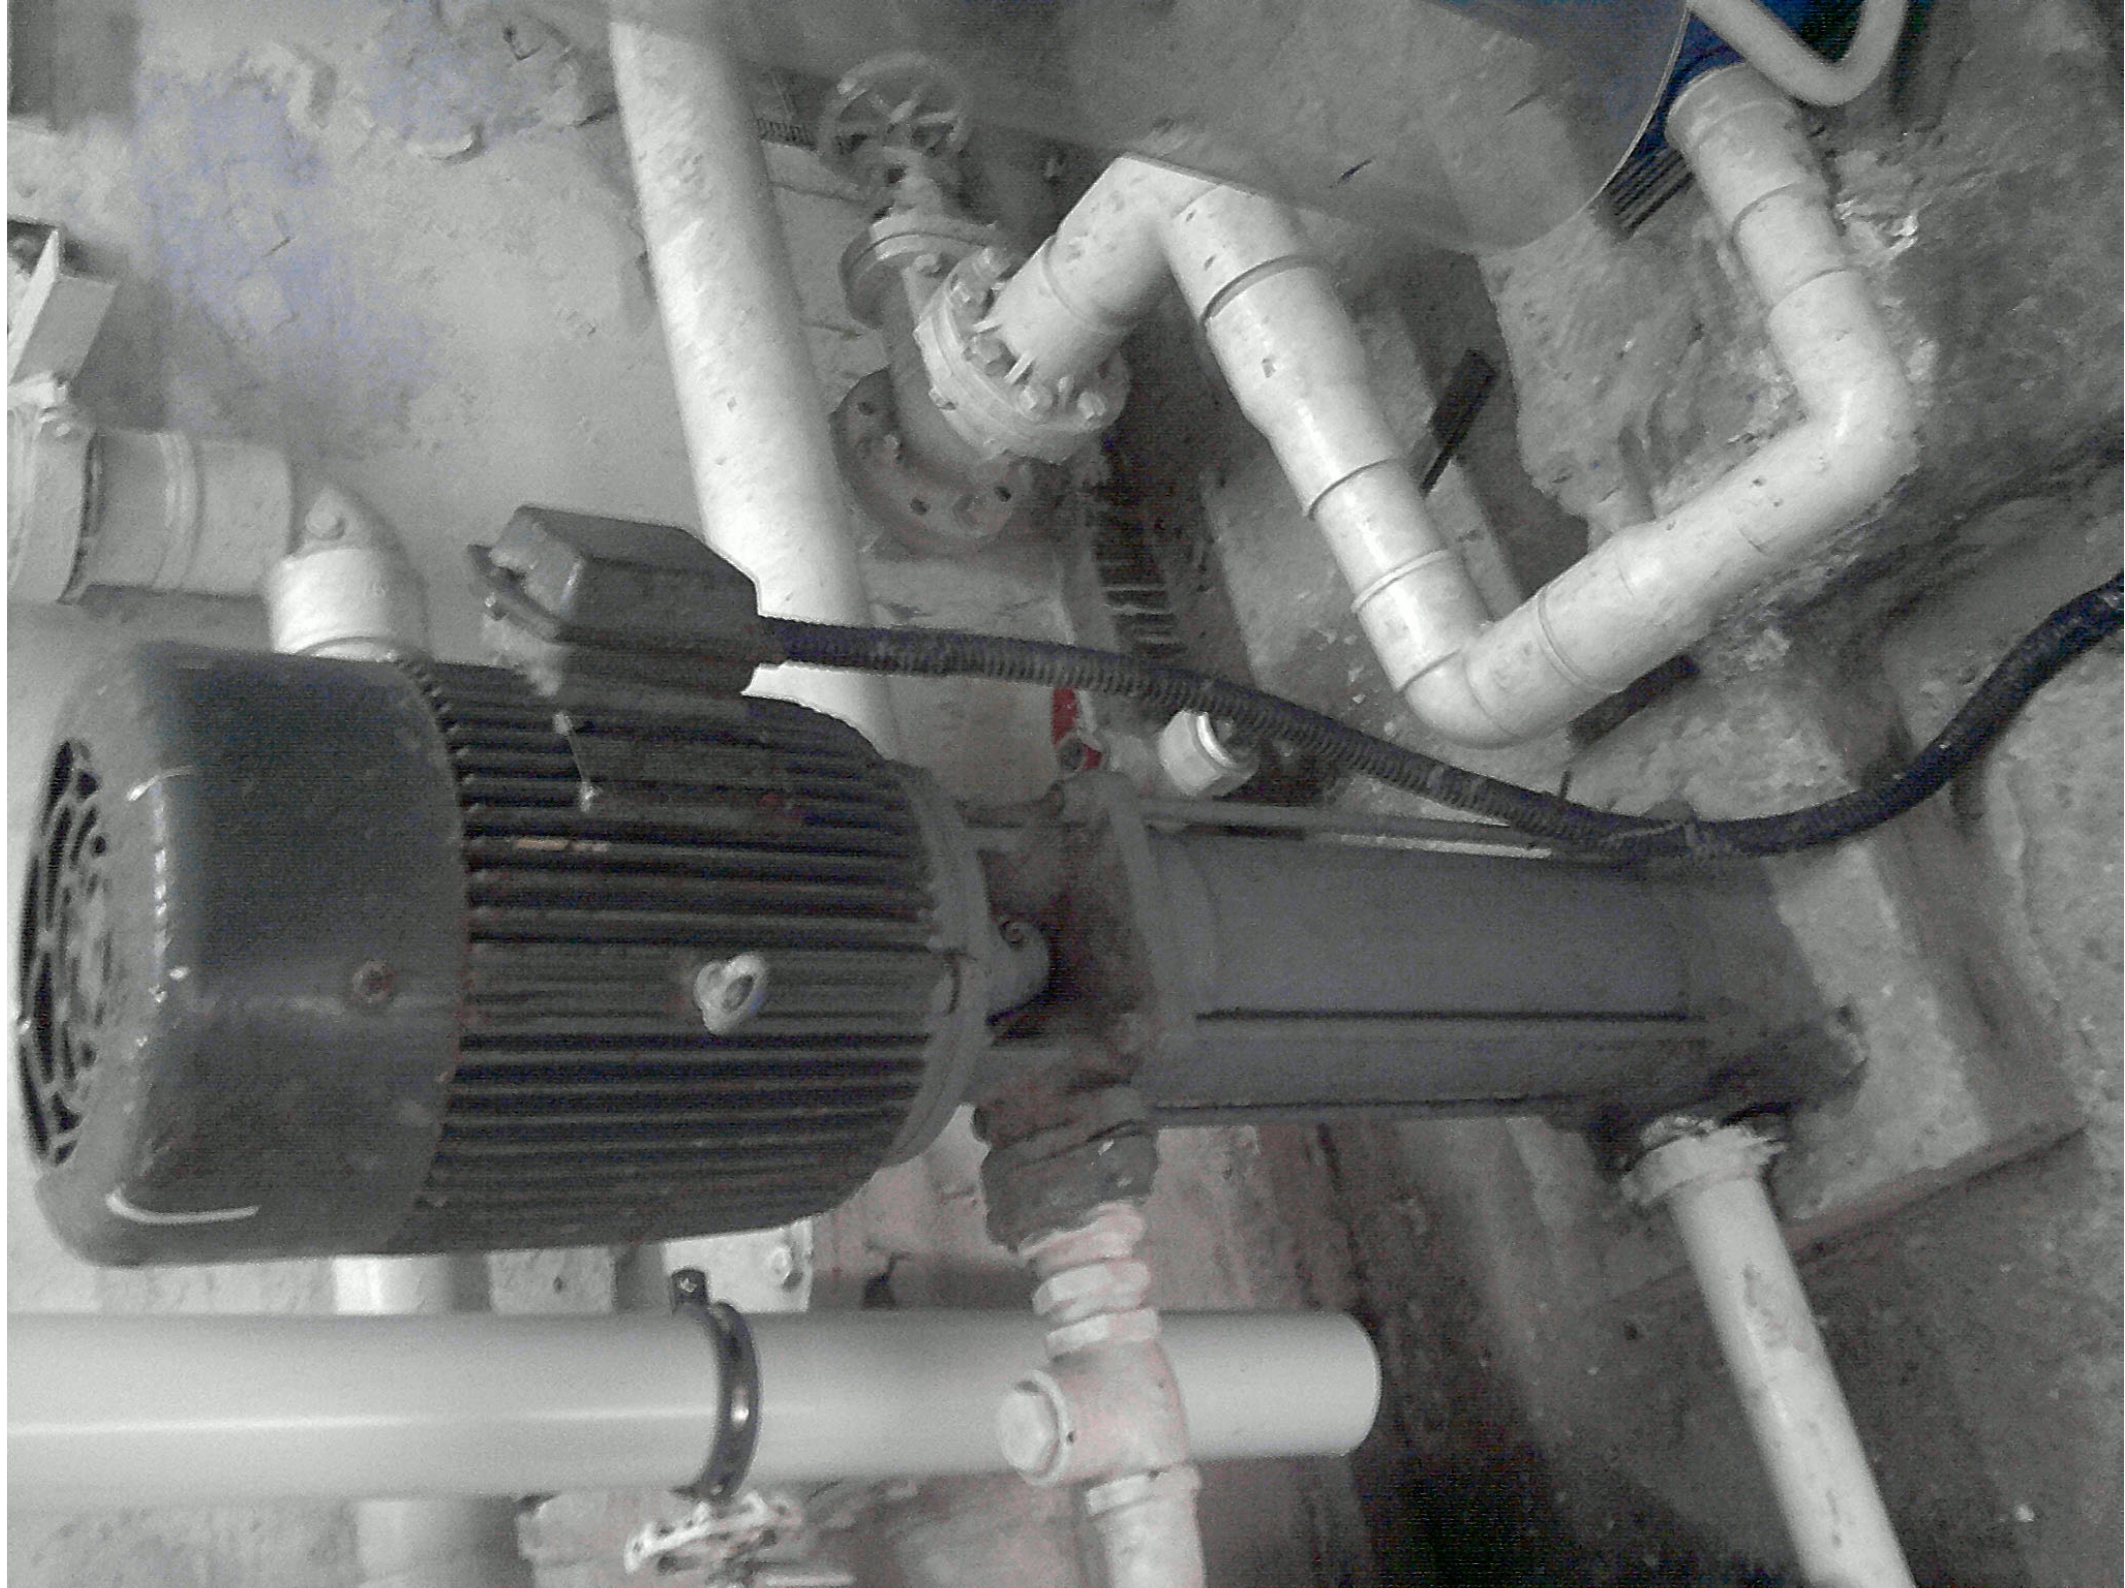



使用消防喉輓  
TO OPERATE FIRE HOSE REEL

- 1 打爛火警鐘掣玻璃  
BREAK GLASS OF THE FIRE ALARM CALL POINT
- 2 先開啓來水掣，再拉出膠喉  
OPEN CONTROL VALVE BEFORE RUNNING OUT HOSE
- 3 將喉咀掣開啓，然後射向火之底部  
TURN ON WATER AT NOZZLE AND  
DIRECT JET AT BASE OF FIRE  
(不適用於電火)  
(NOT SUITABLE FOR ELECTRICAL FIRES)

消防用水  
USE OF WATER FROM FIRE SERVICES FOR PURPOSES  
OTHER THAN FIRE FIGHTING IS STRICTLY PROHIBITED  
嚴禁作其他用途  
水務監督辦事處  
Office of the Water Authority

















# 新建花灑及消防系統












# 學校偵測系統及警報系統新增

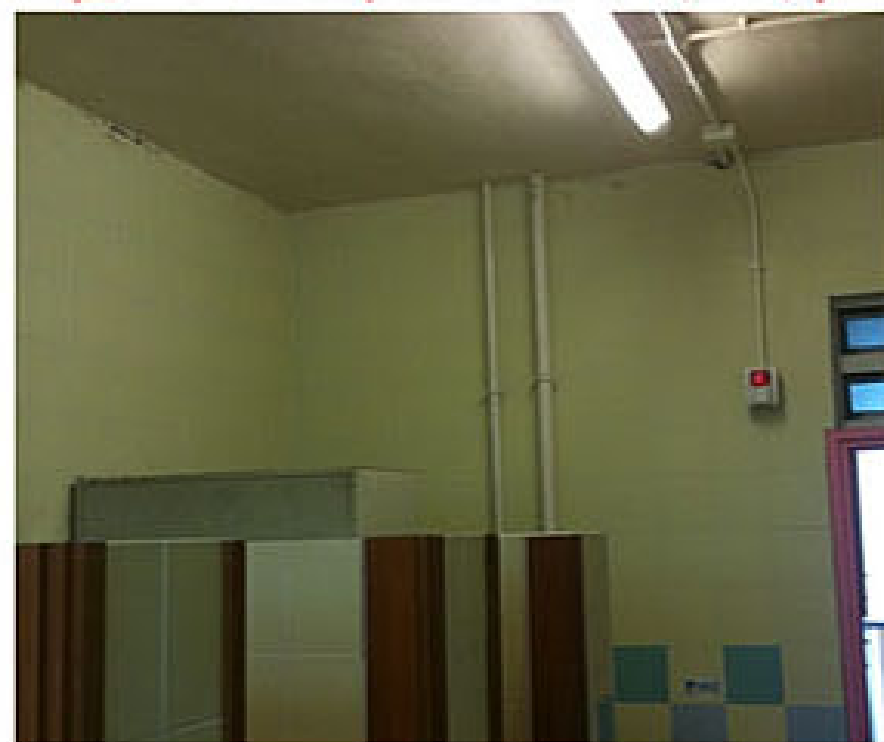






















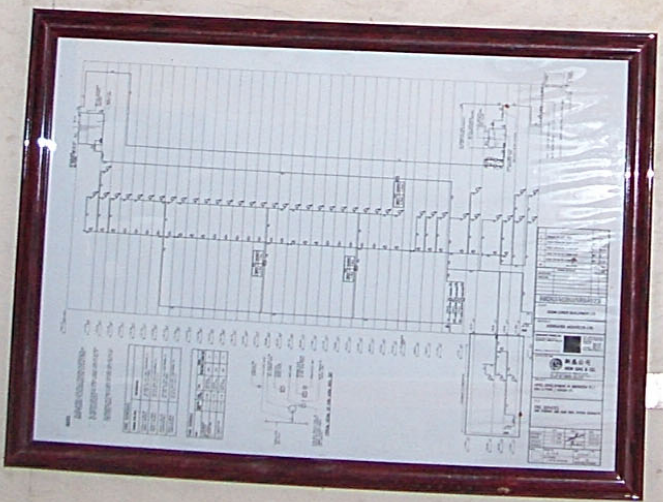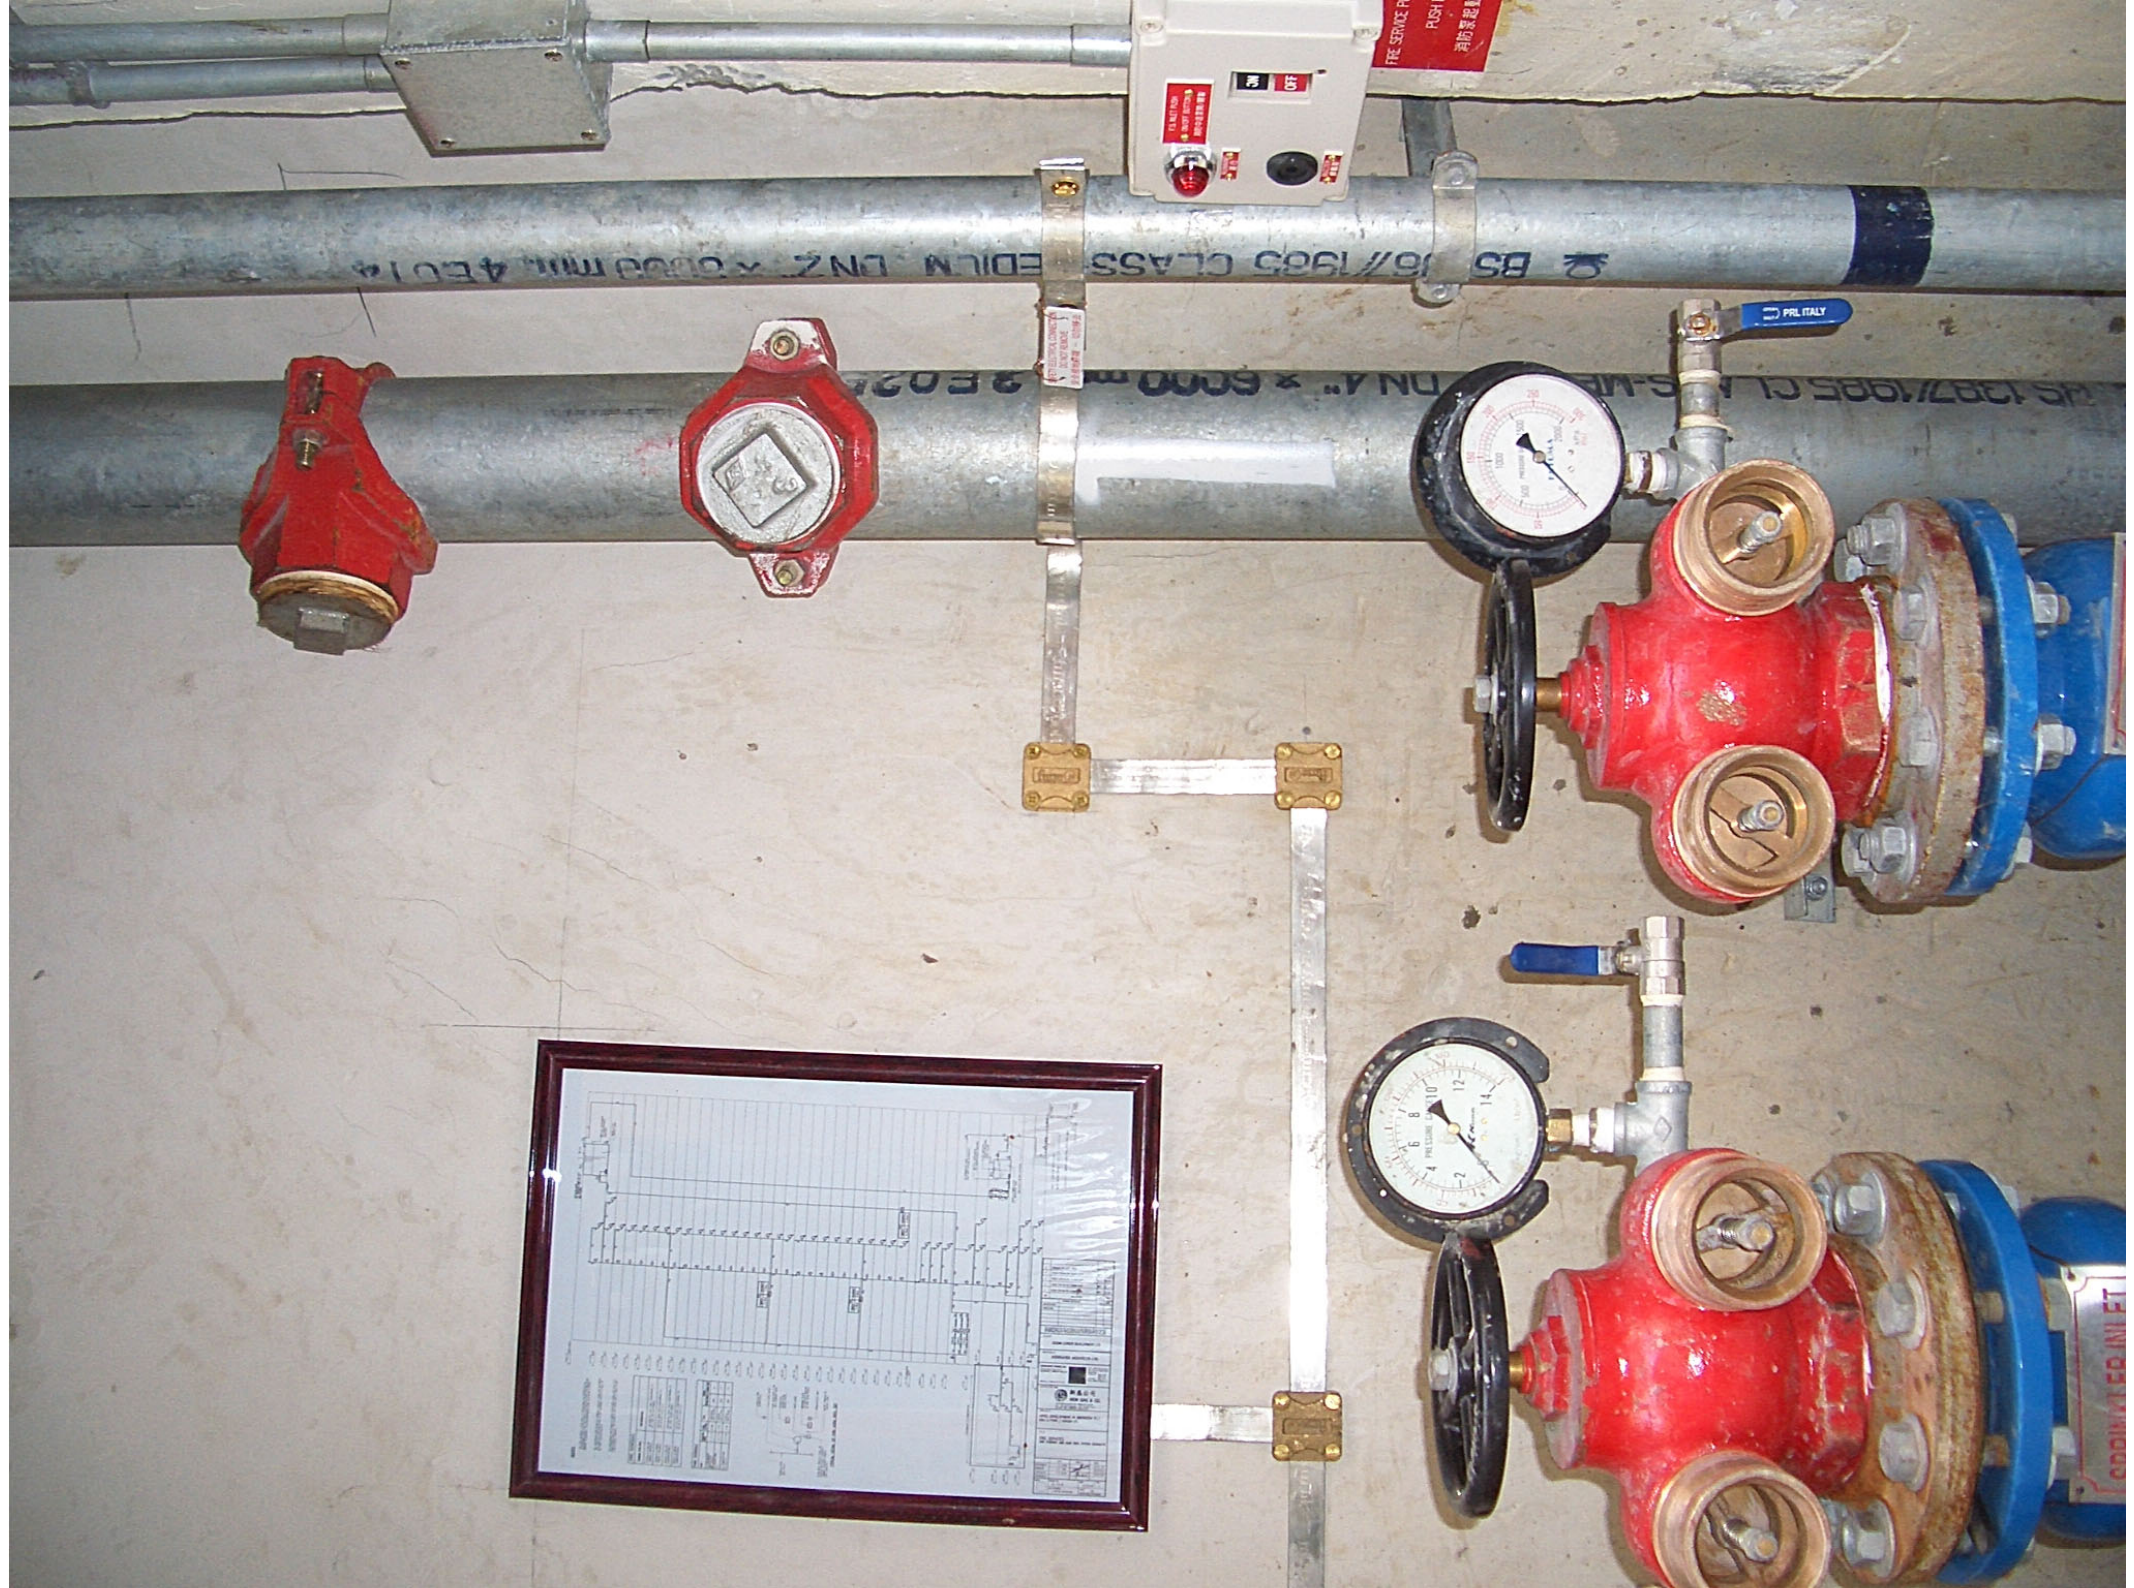



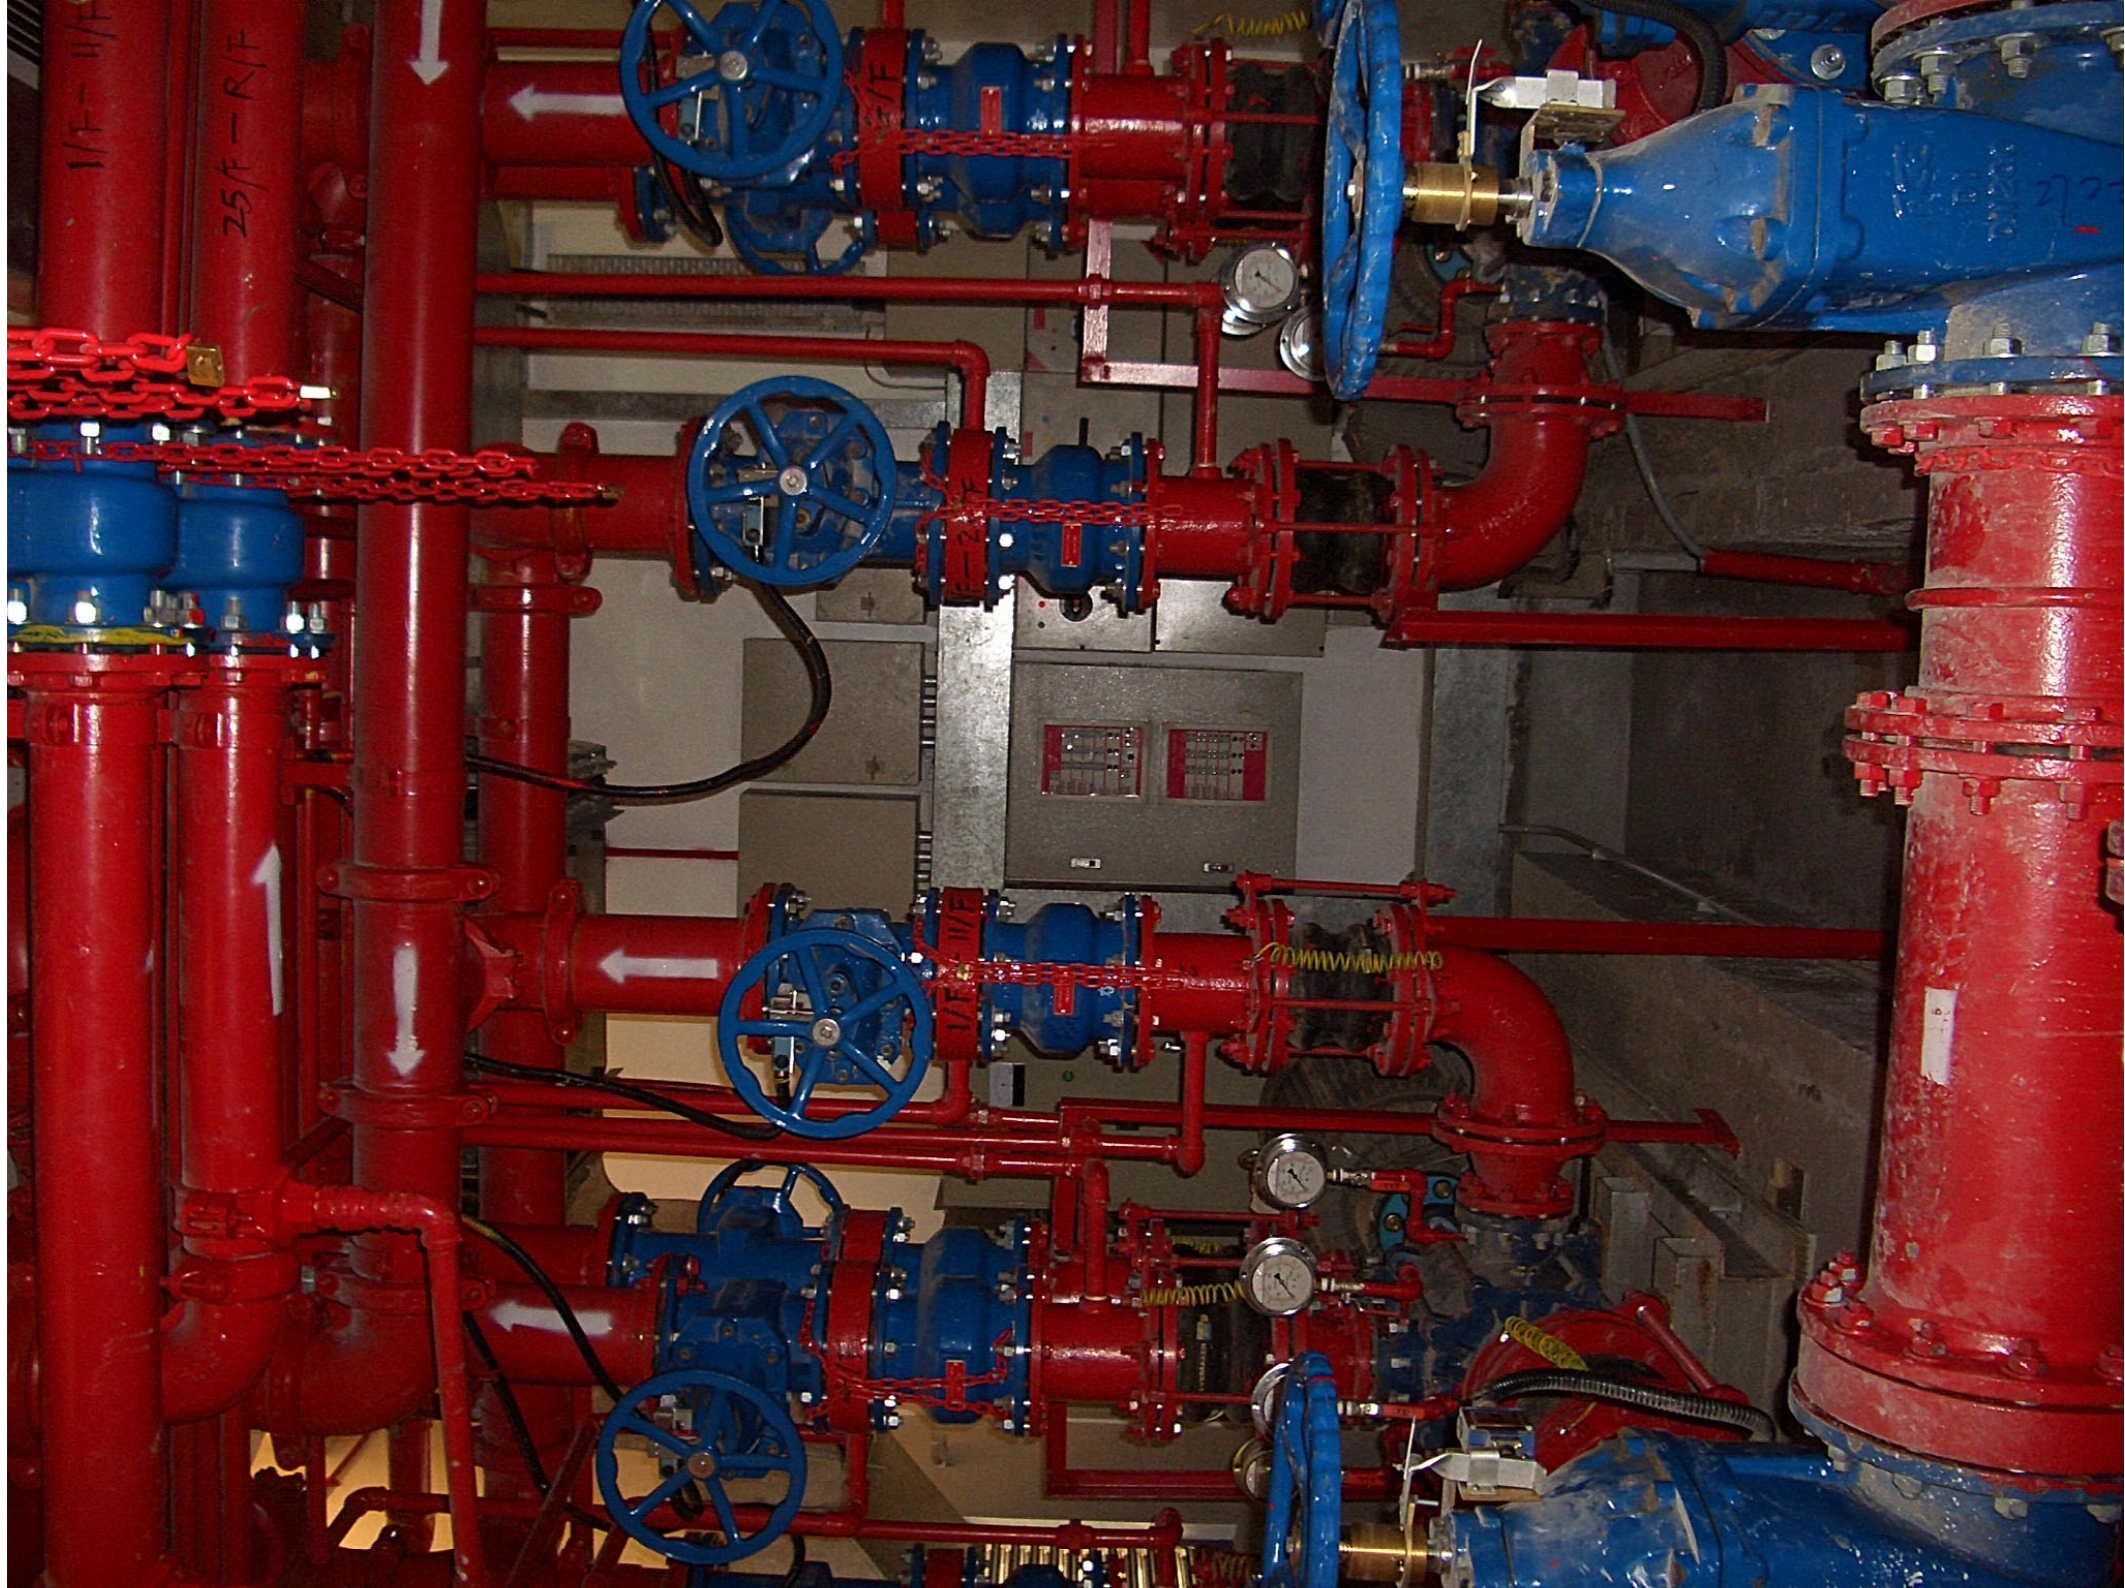




















EXIT 出口





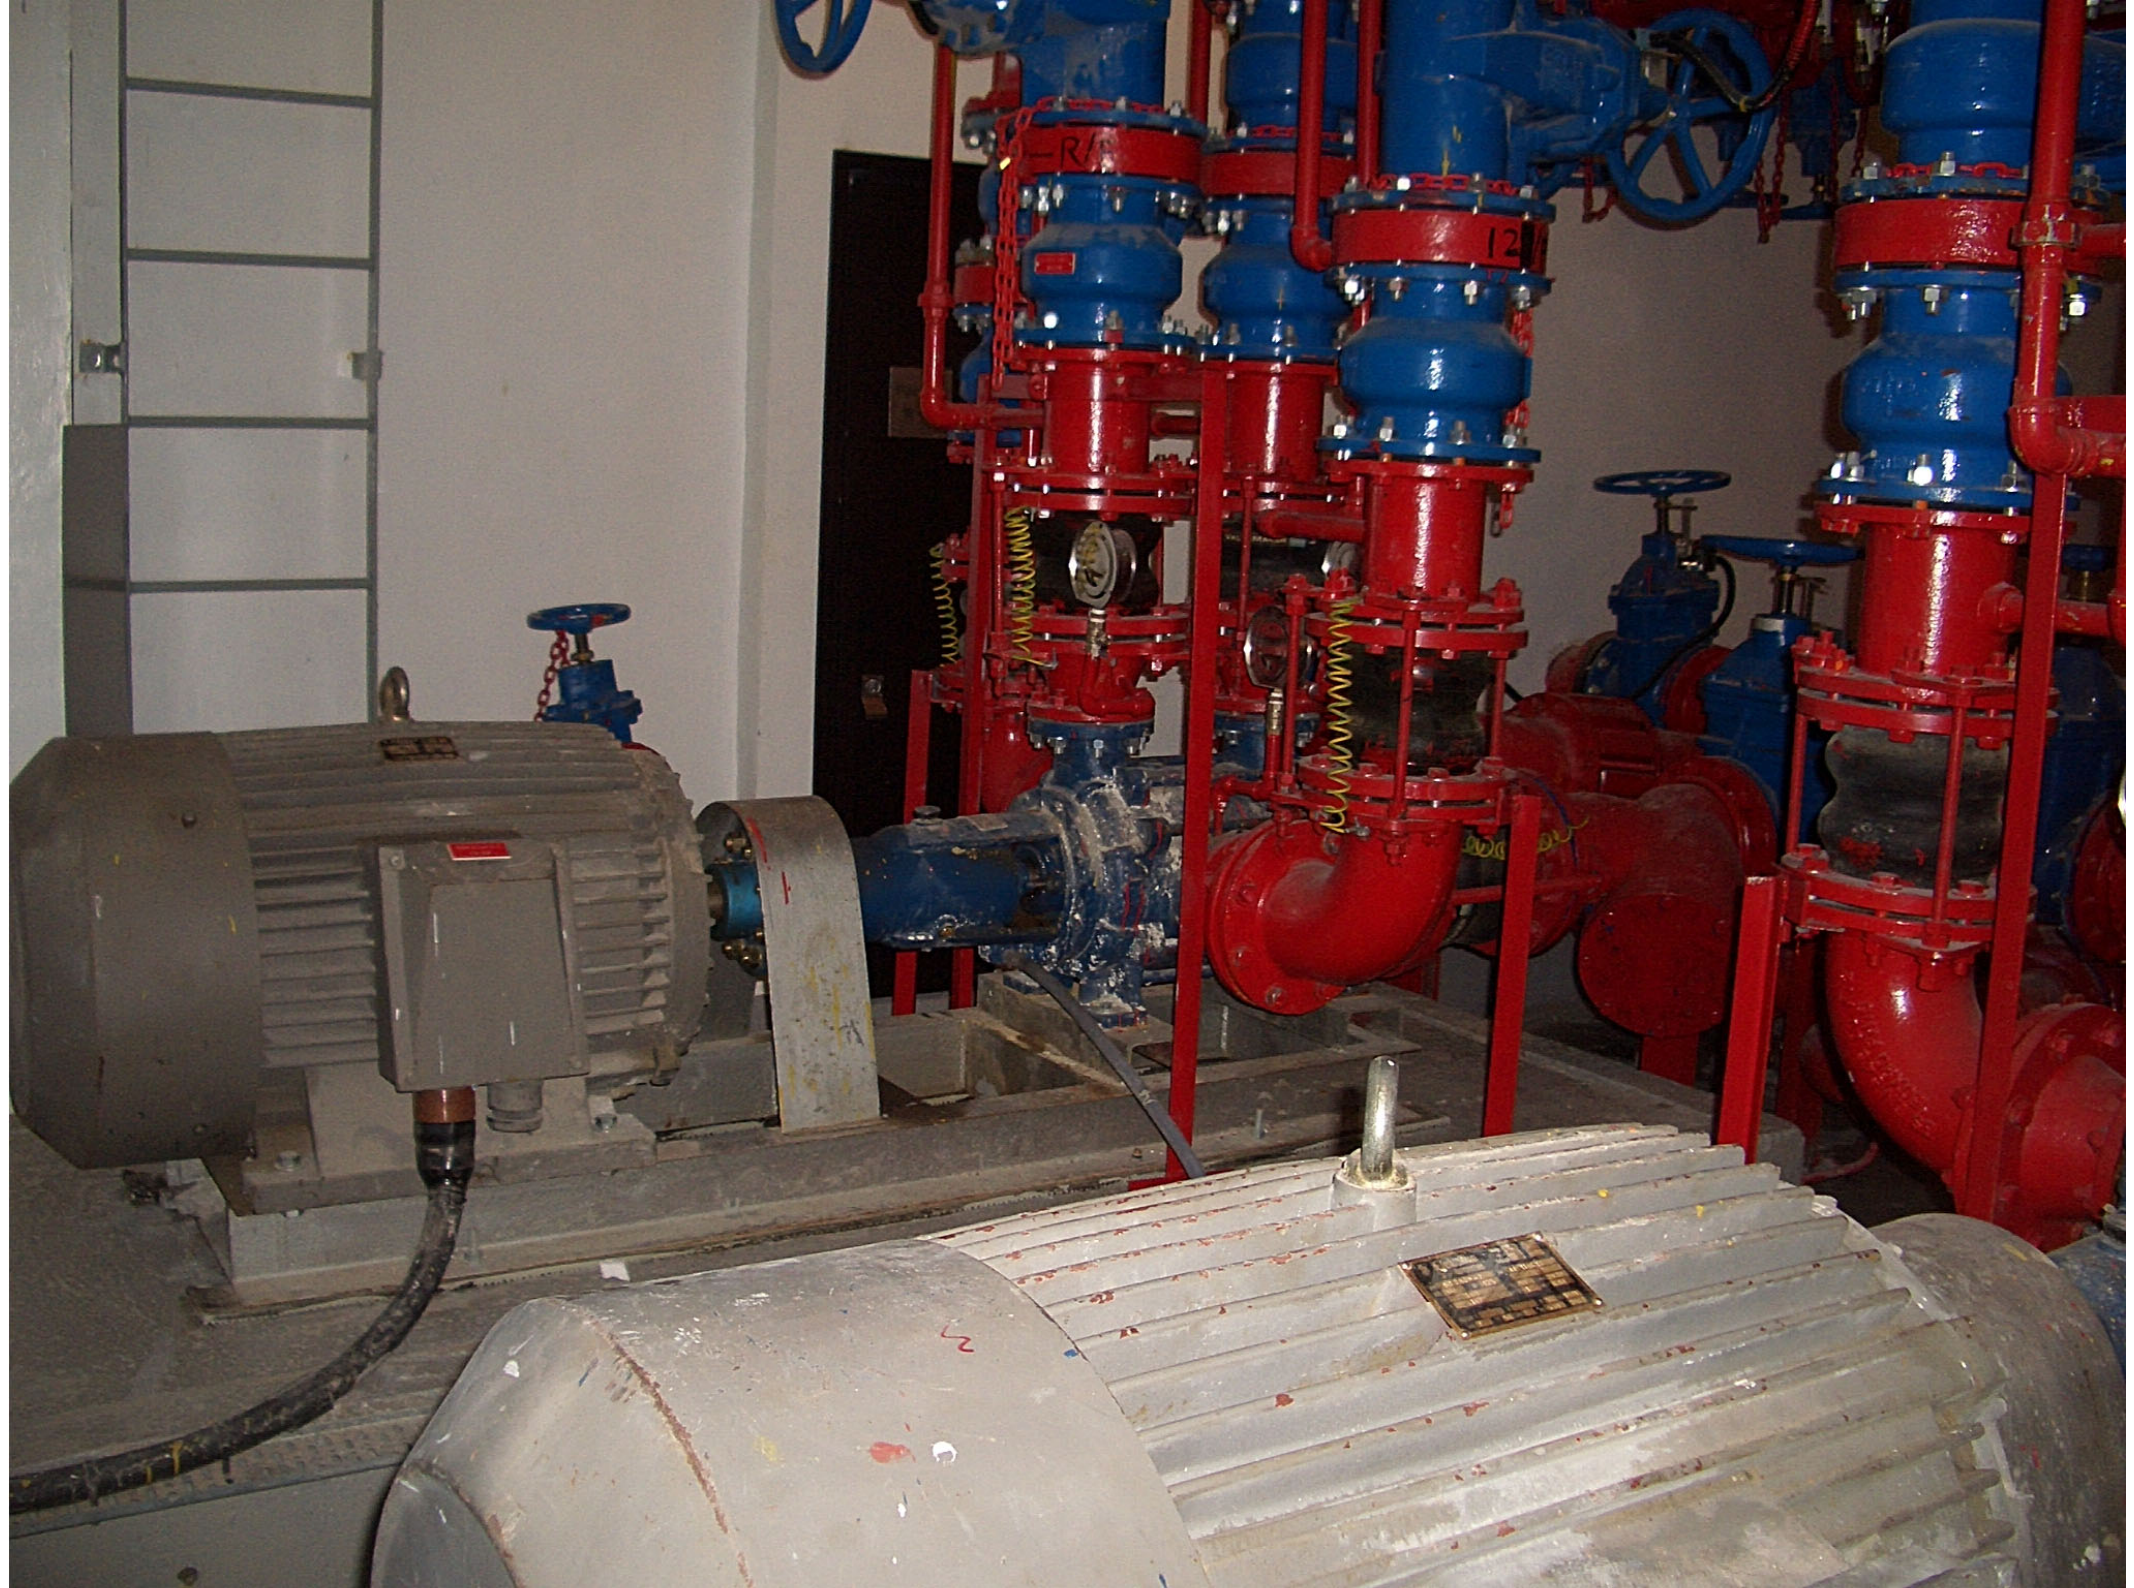







EXIT



















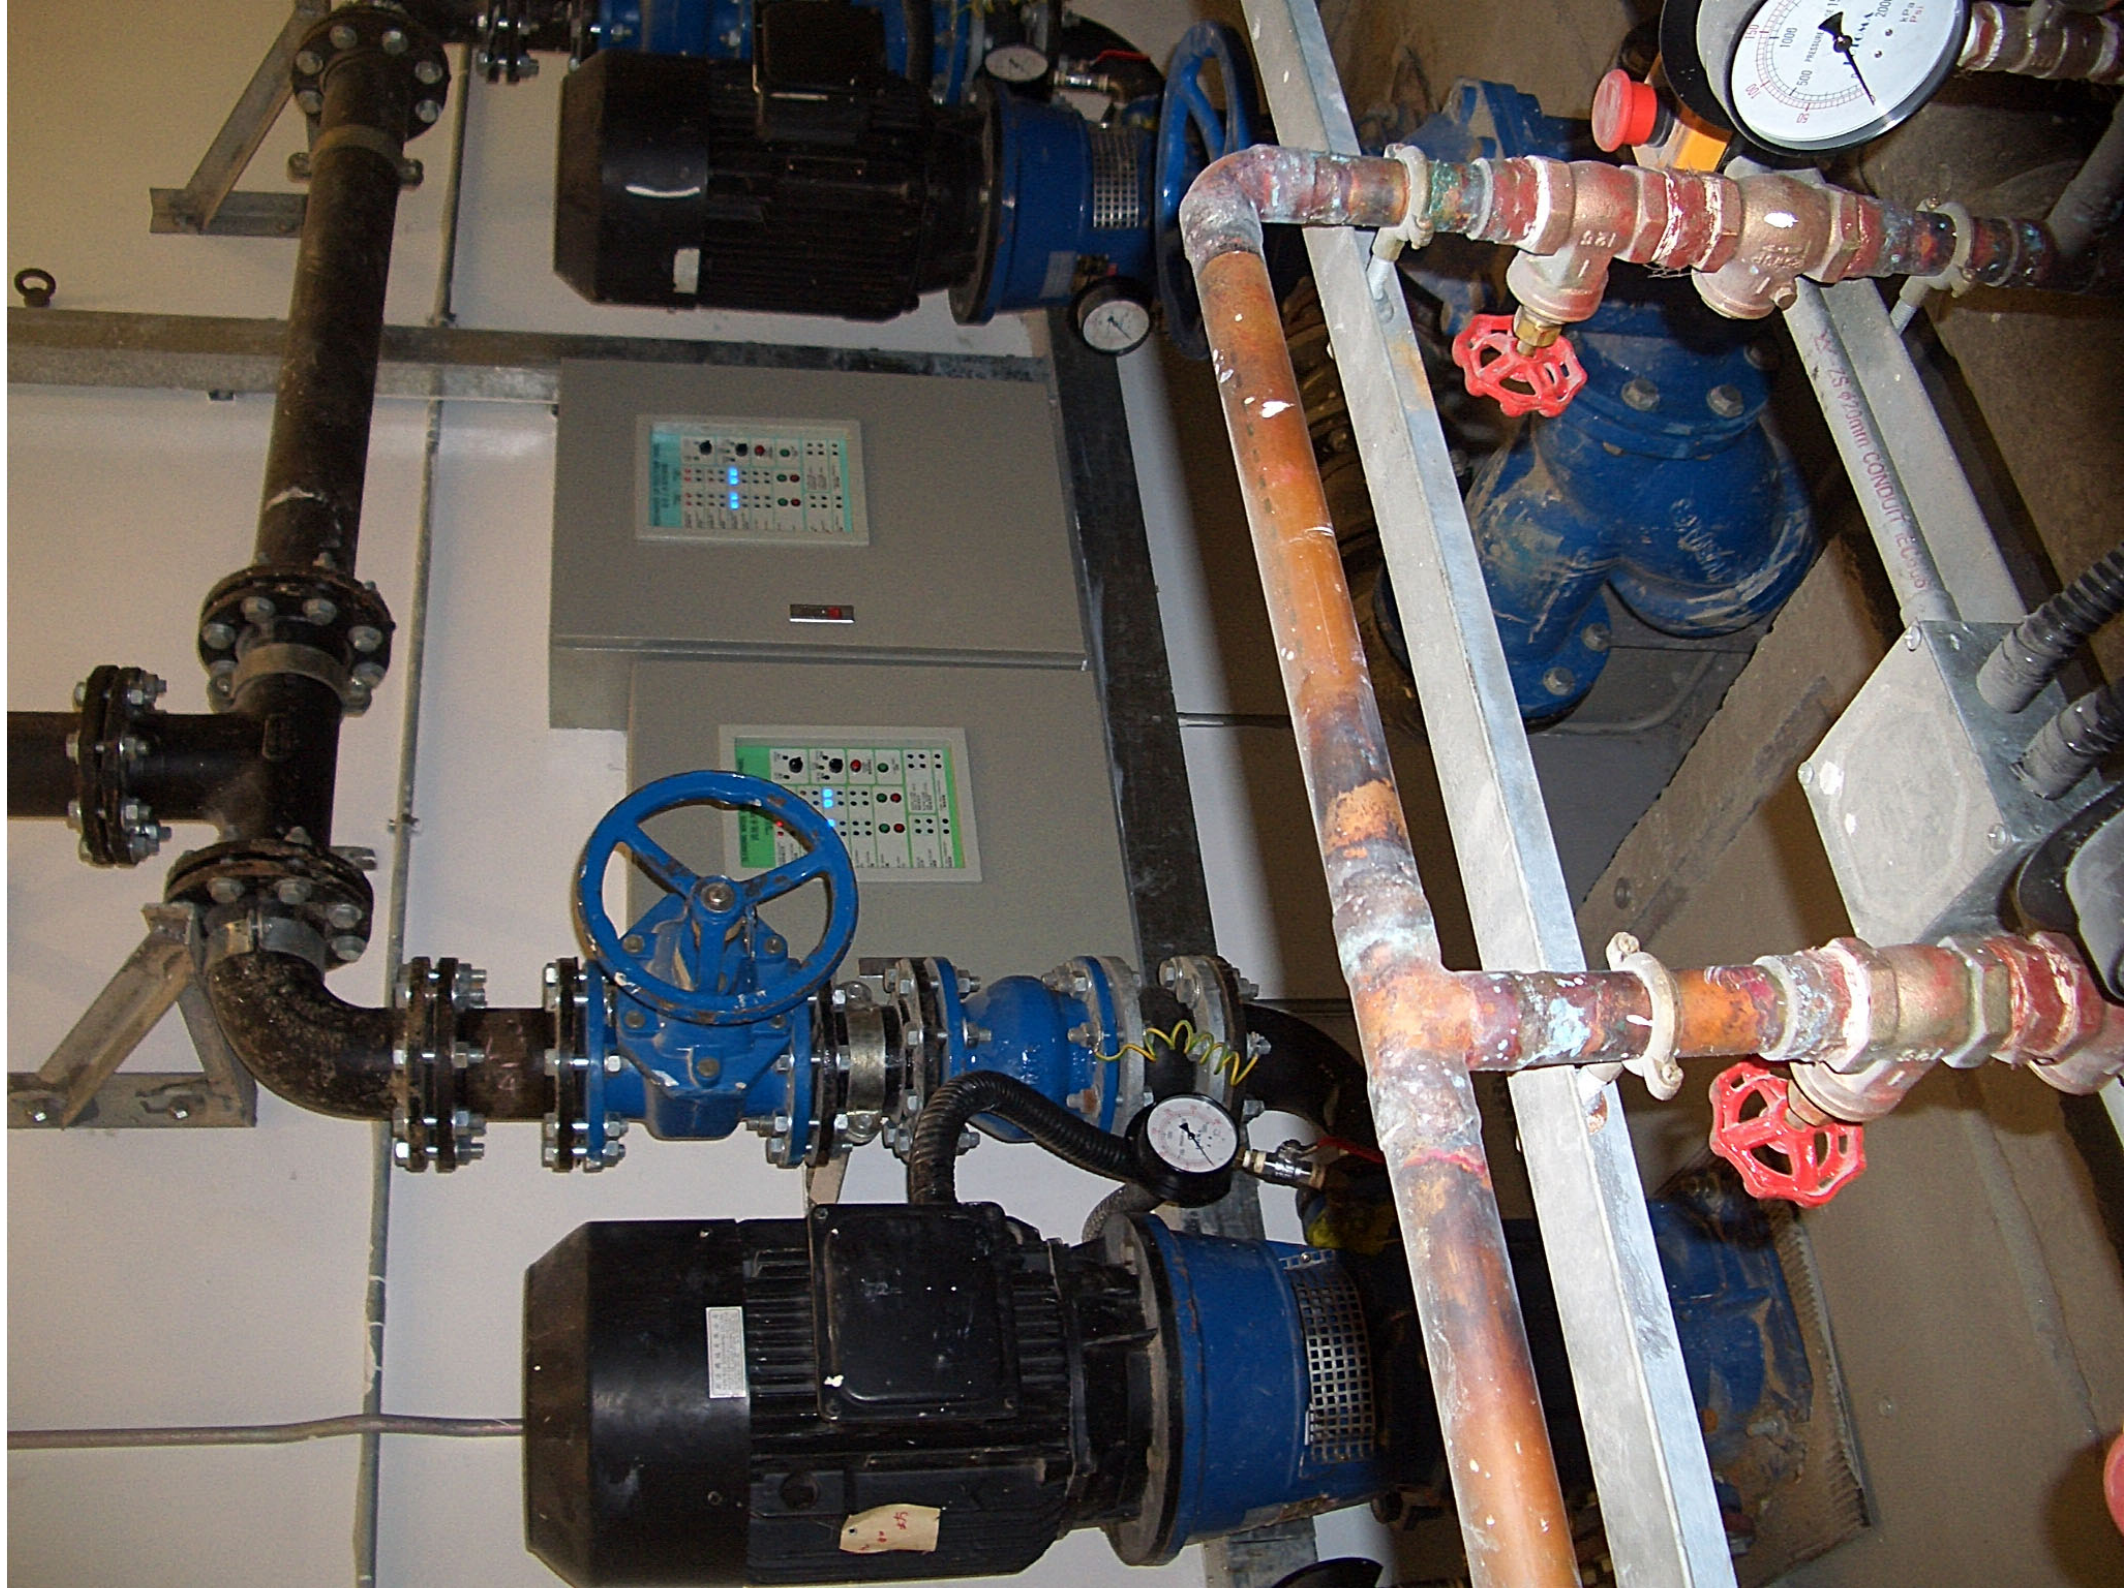







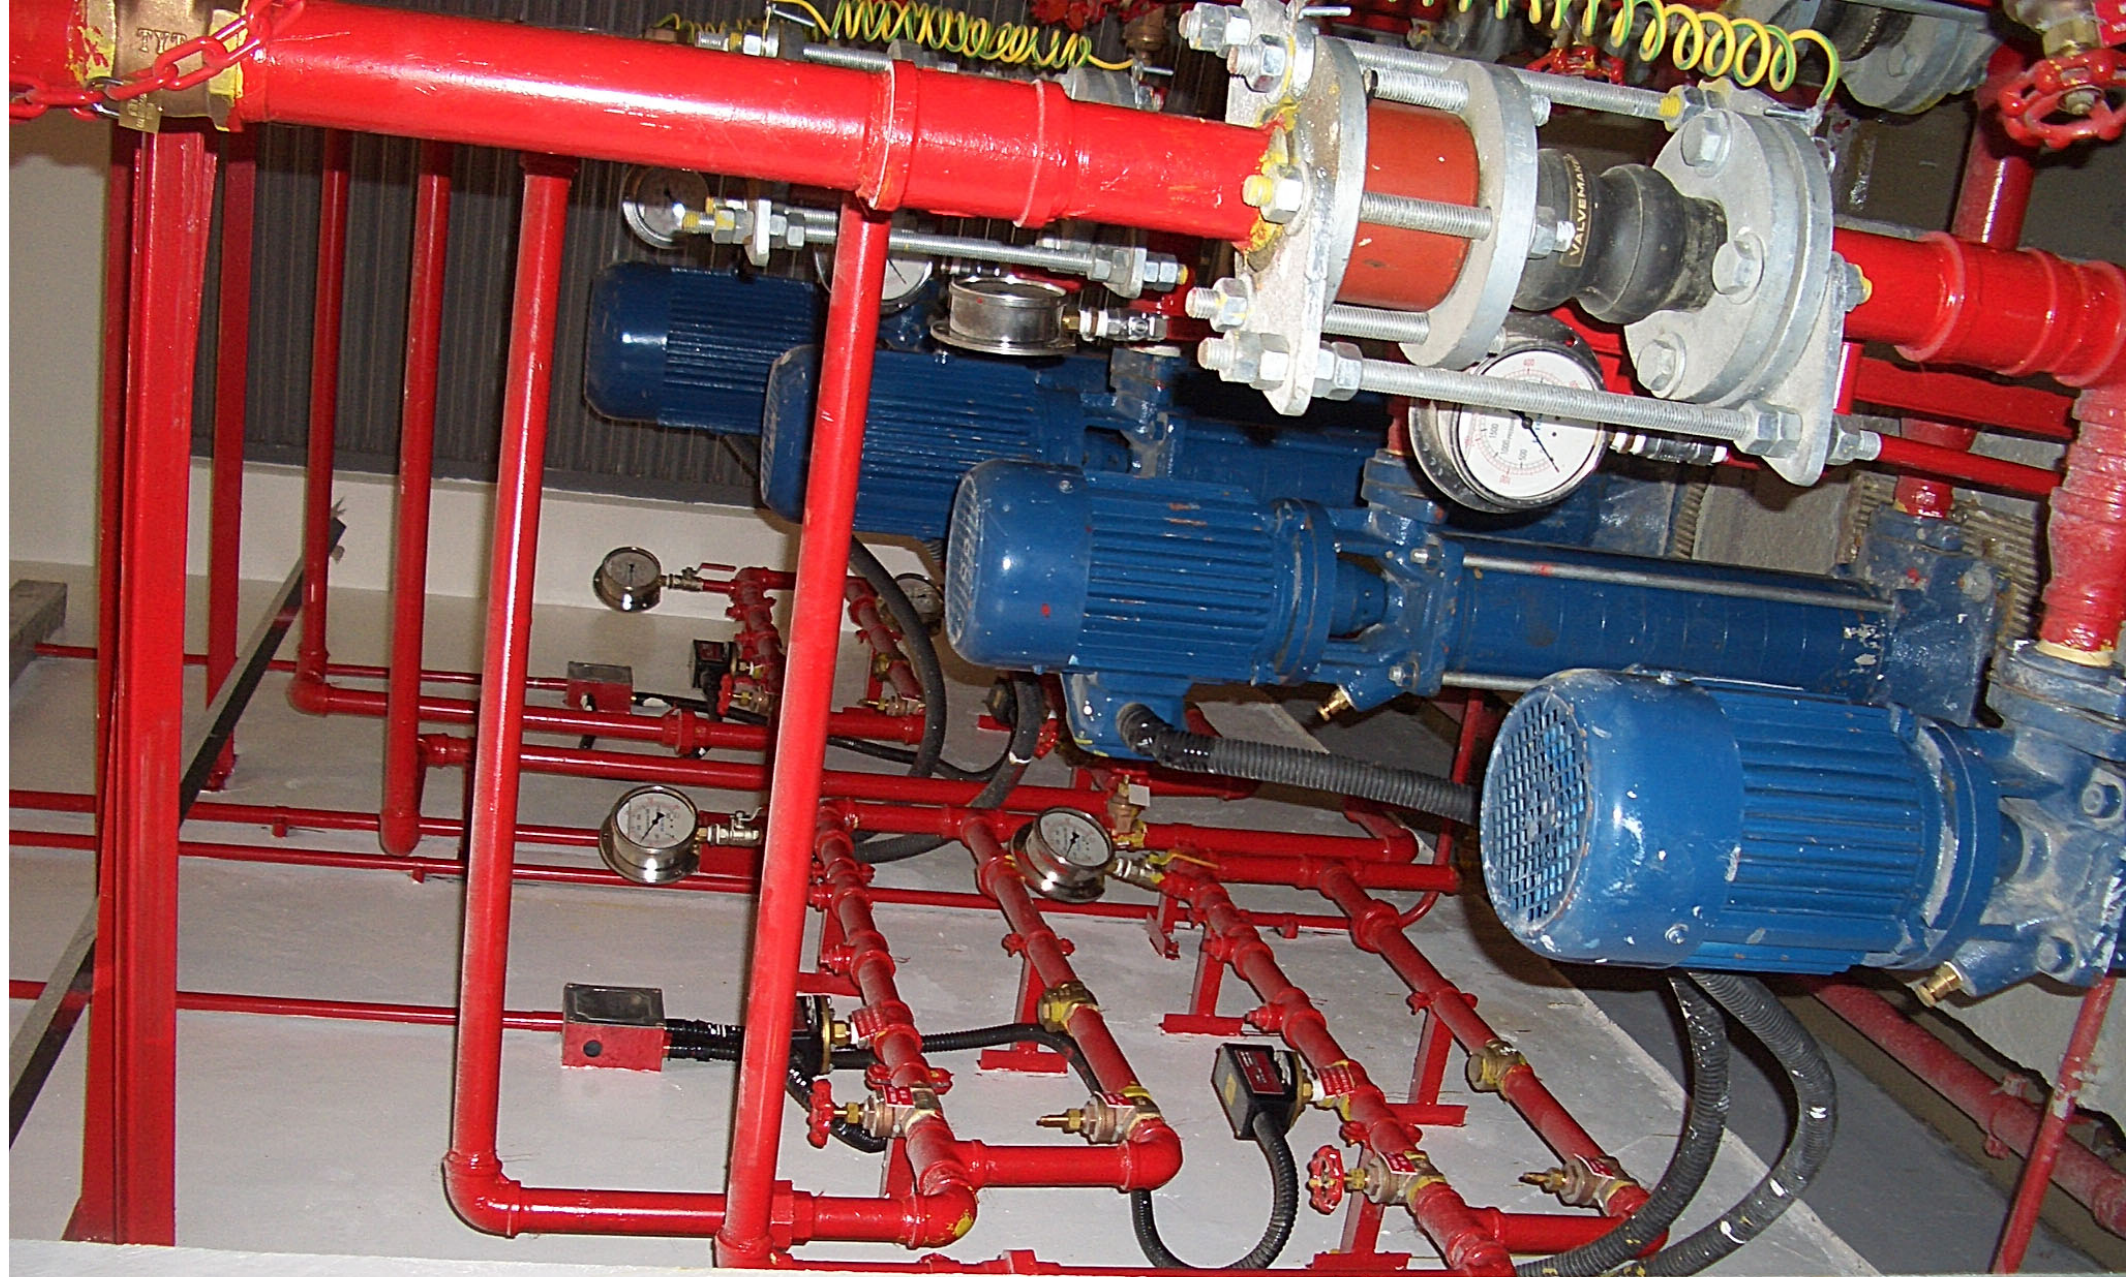








EXIT






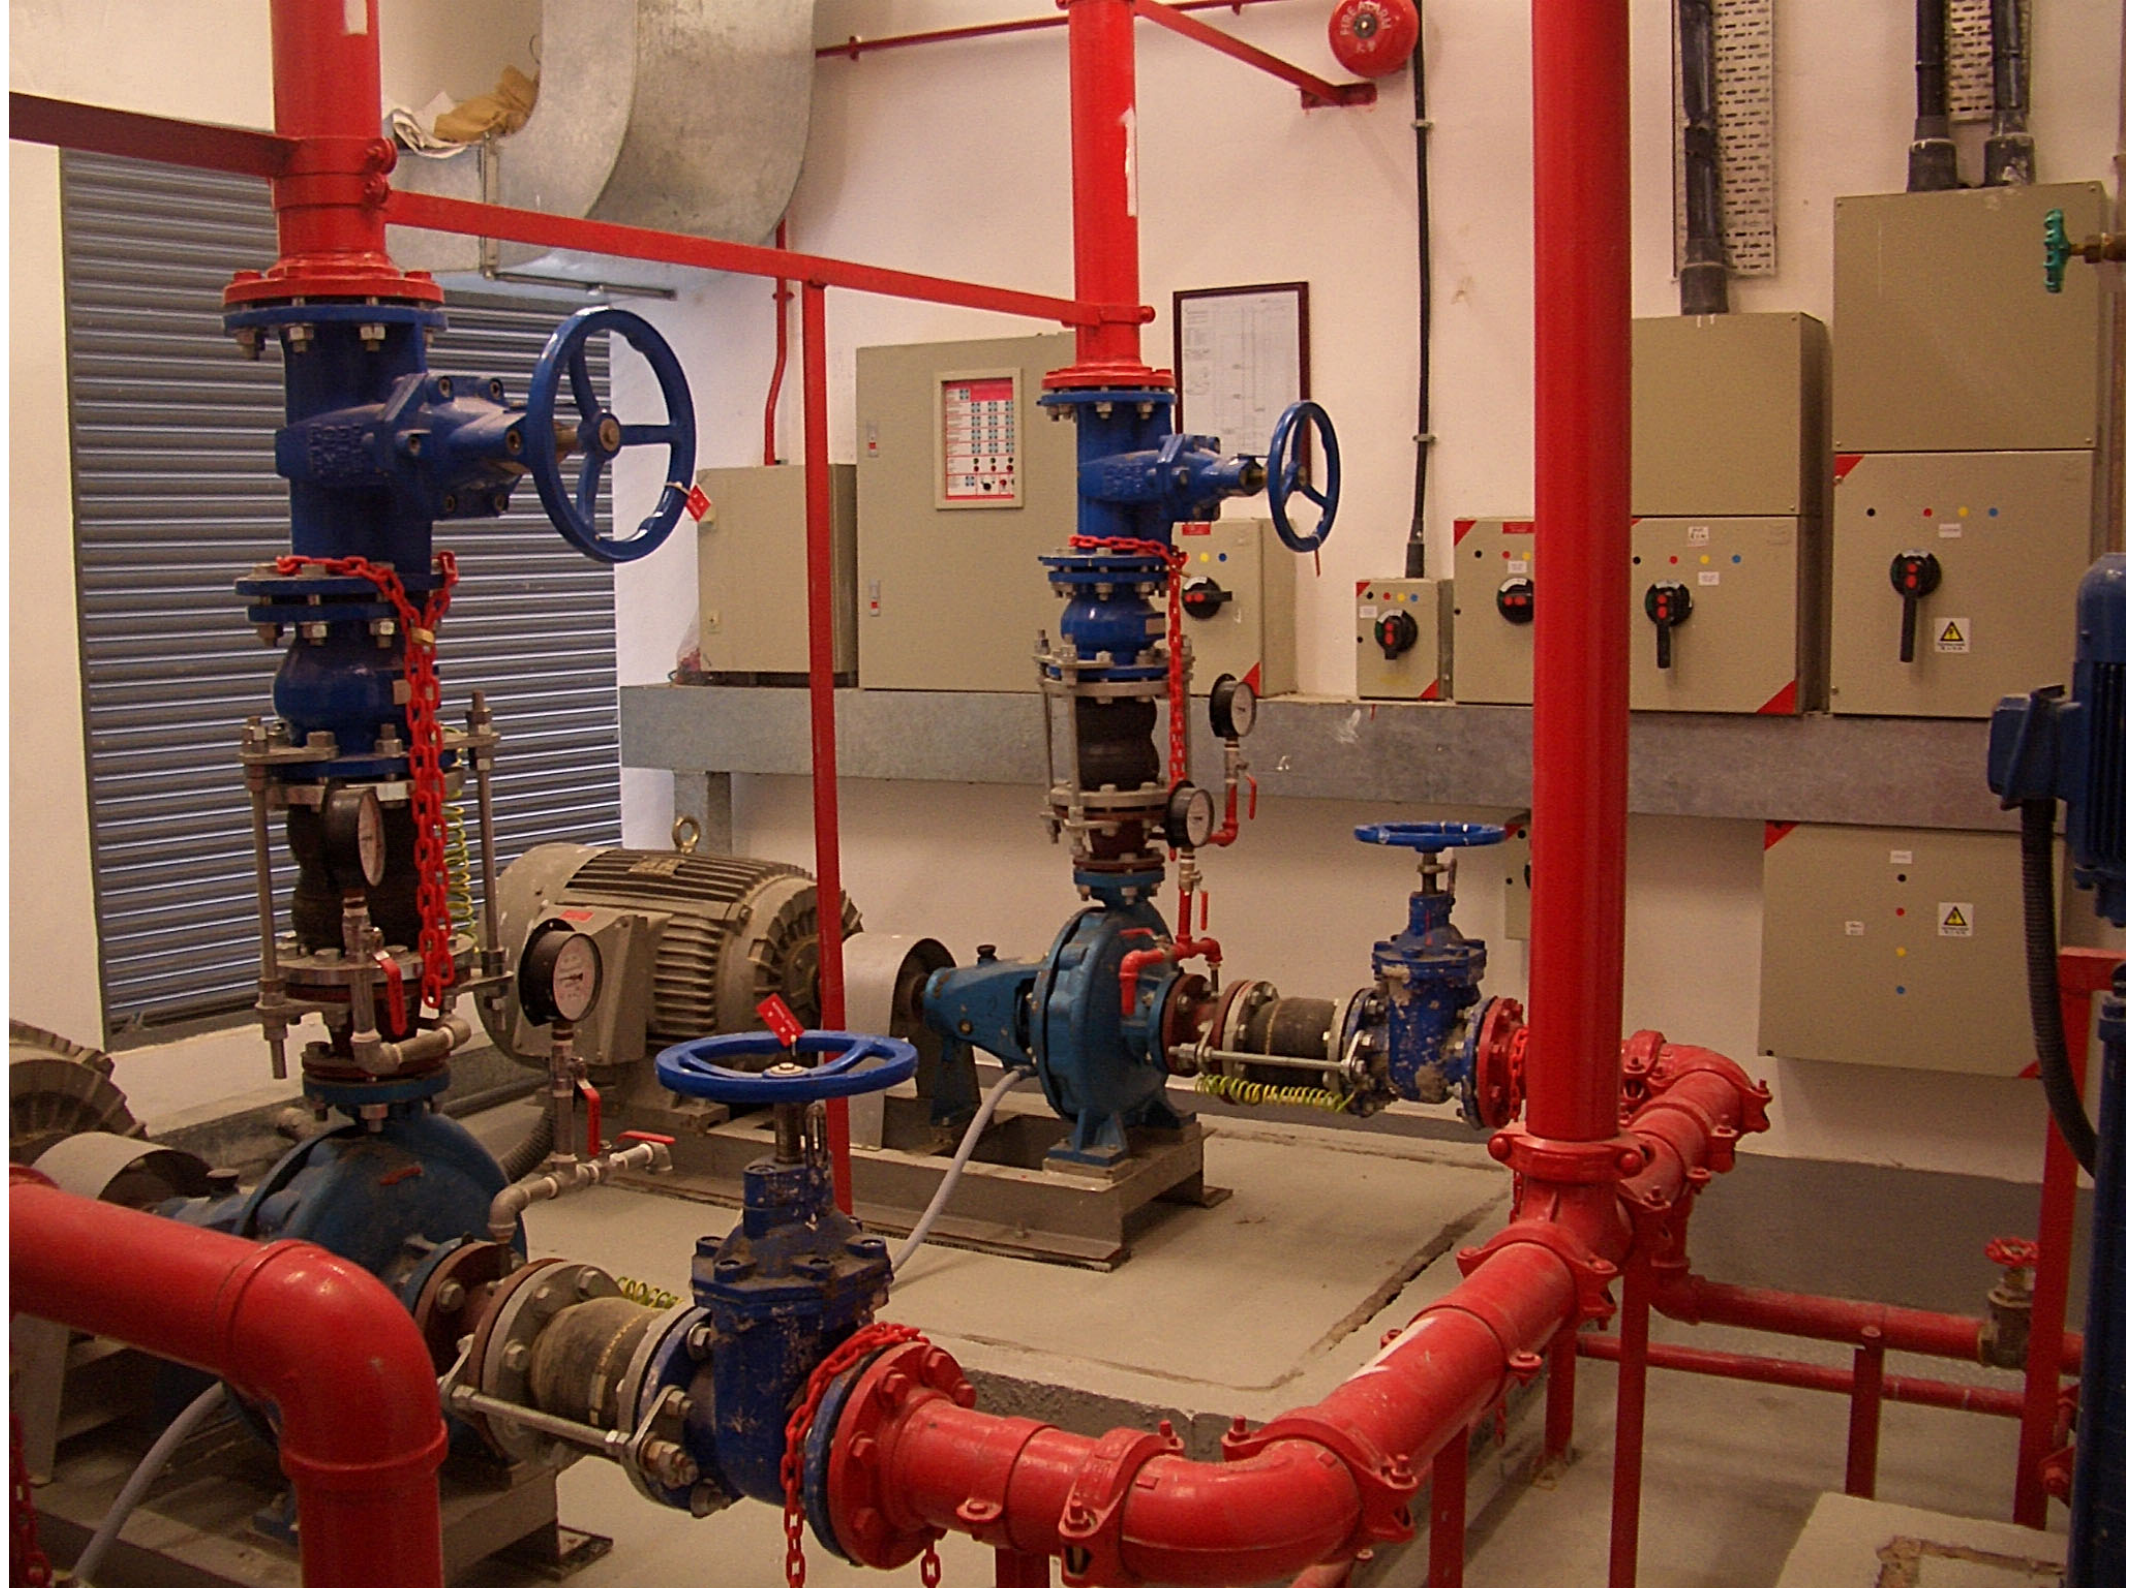







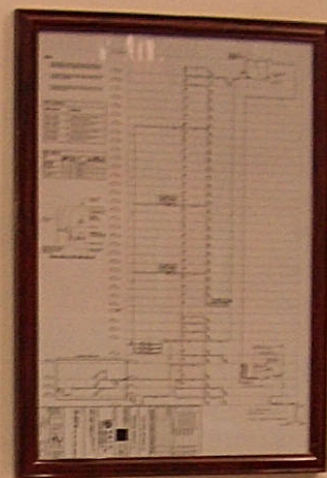












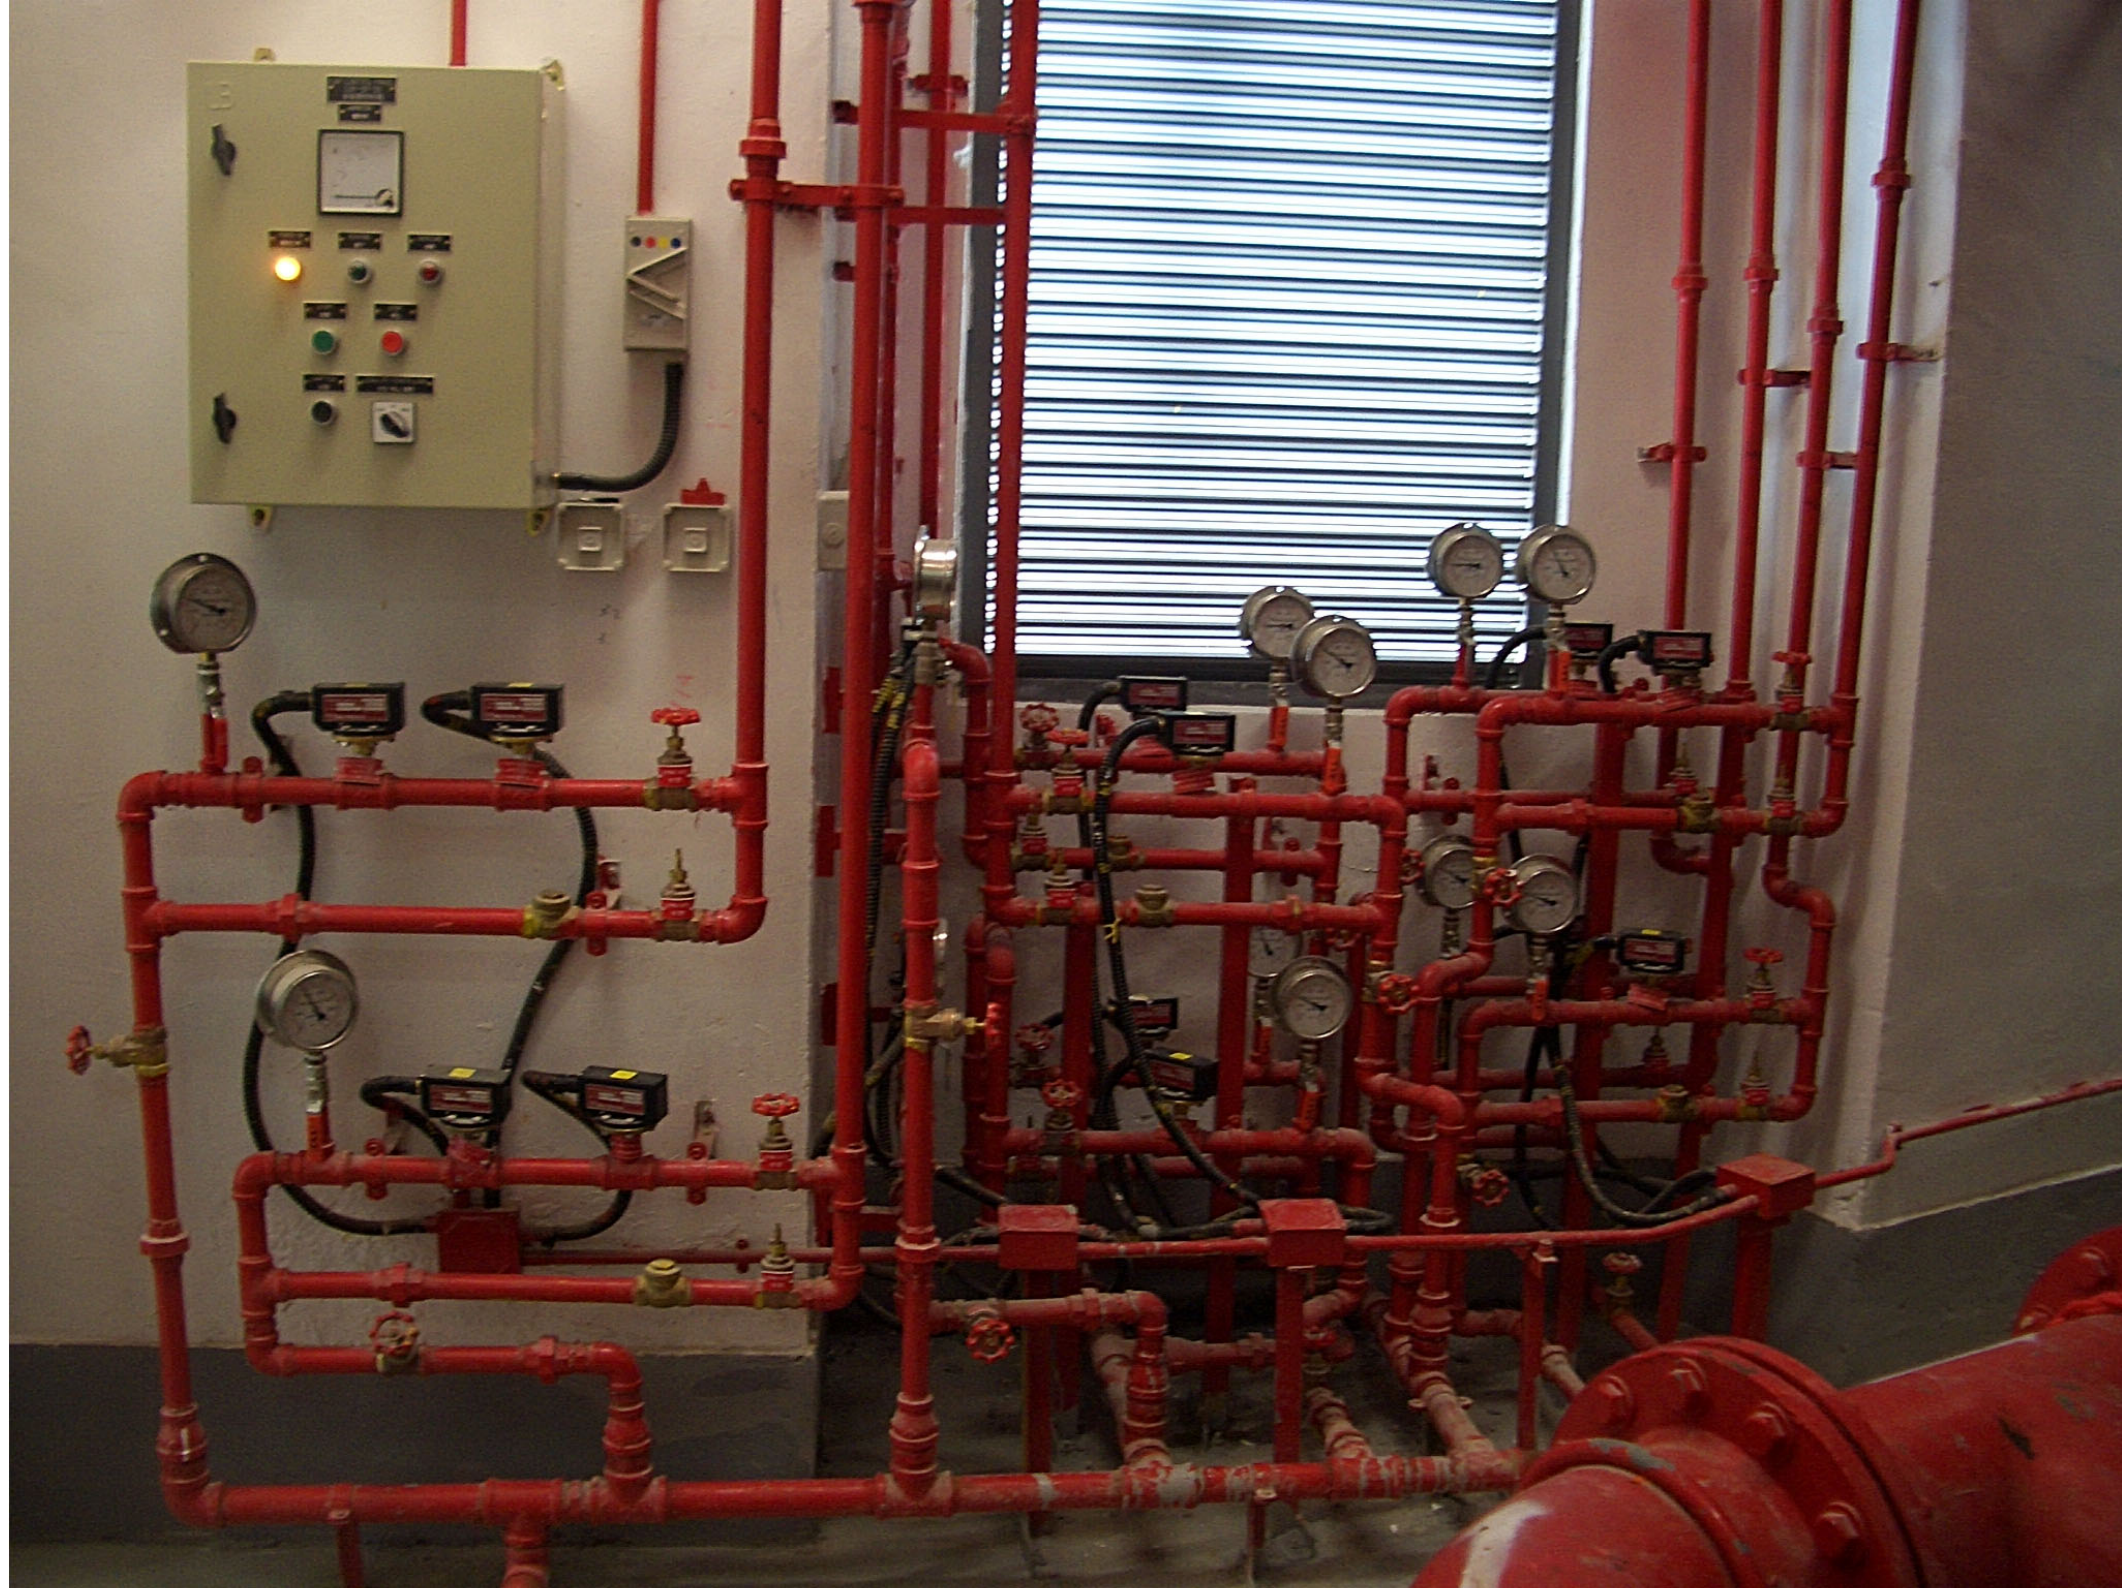


















0366

2004/02/03 14:44:57



















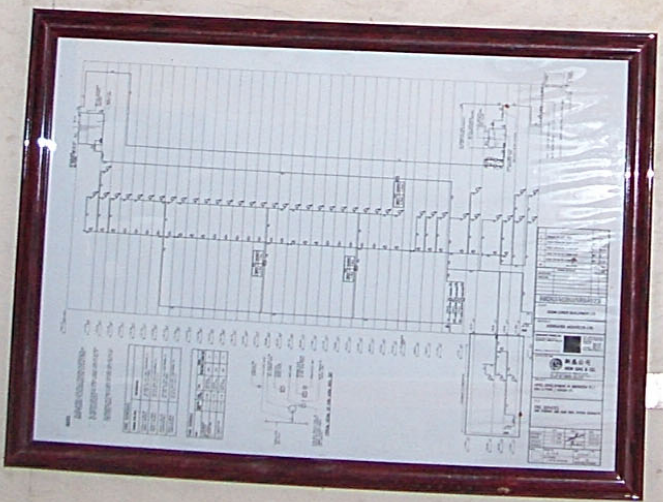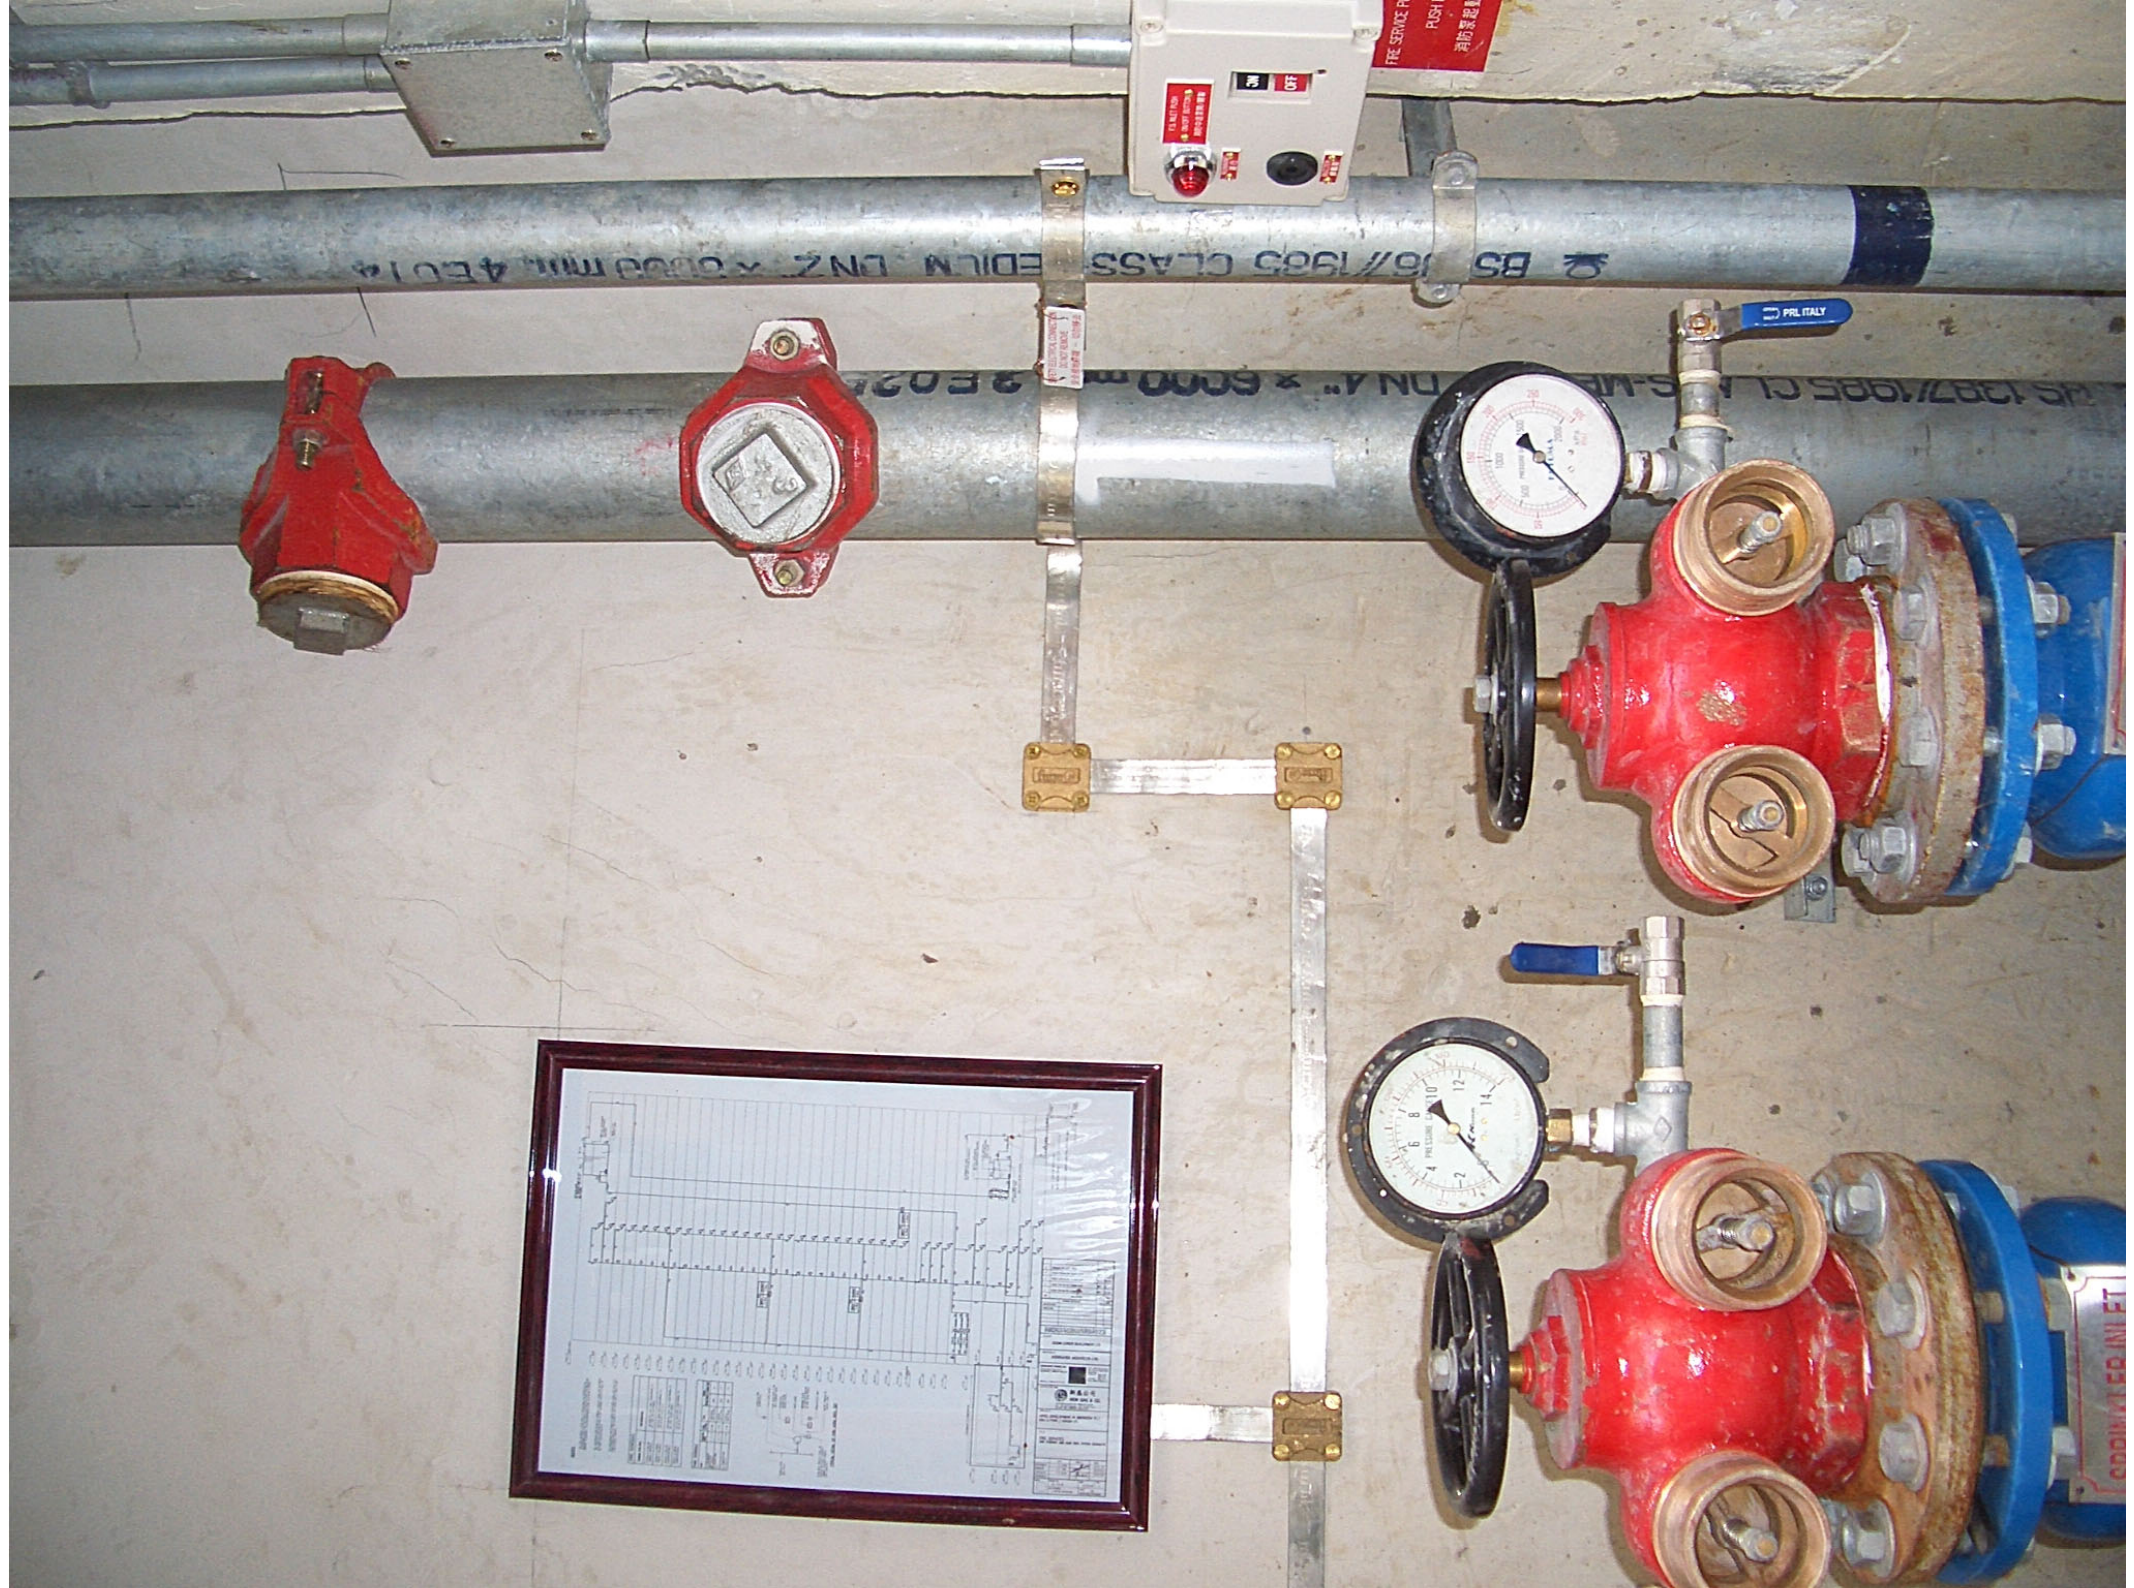




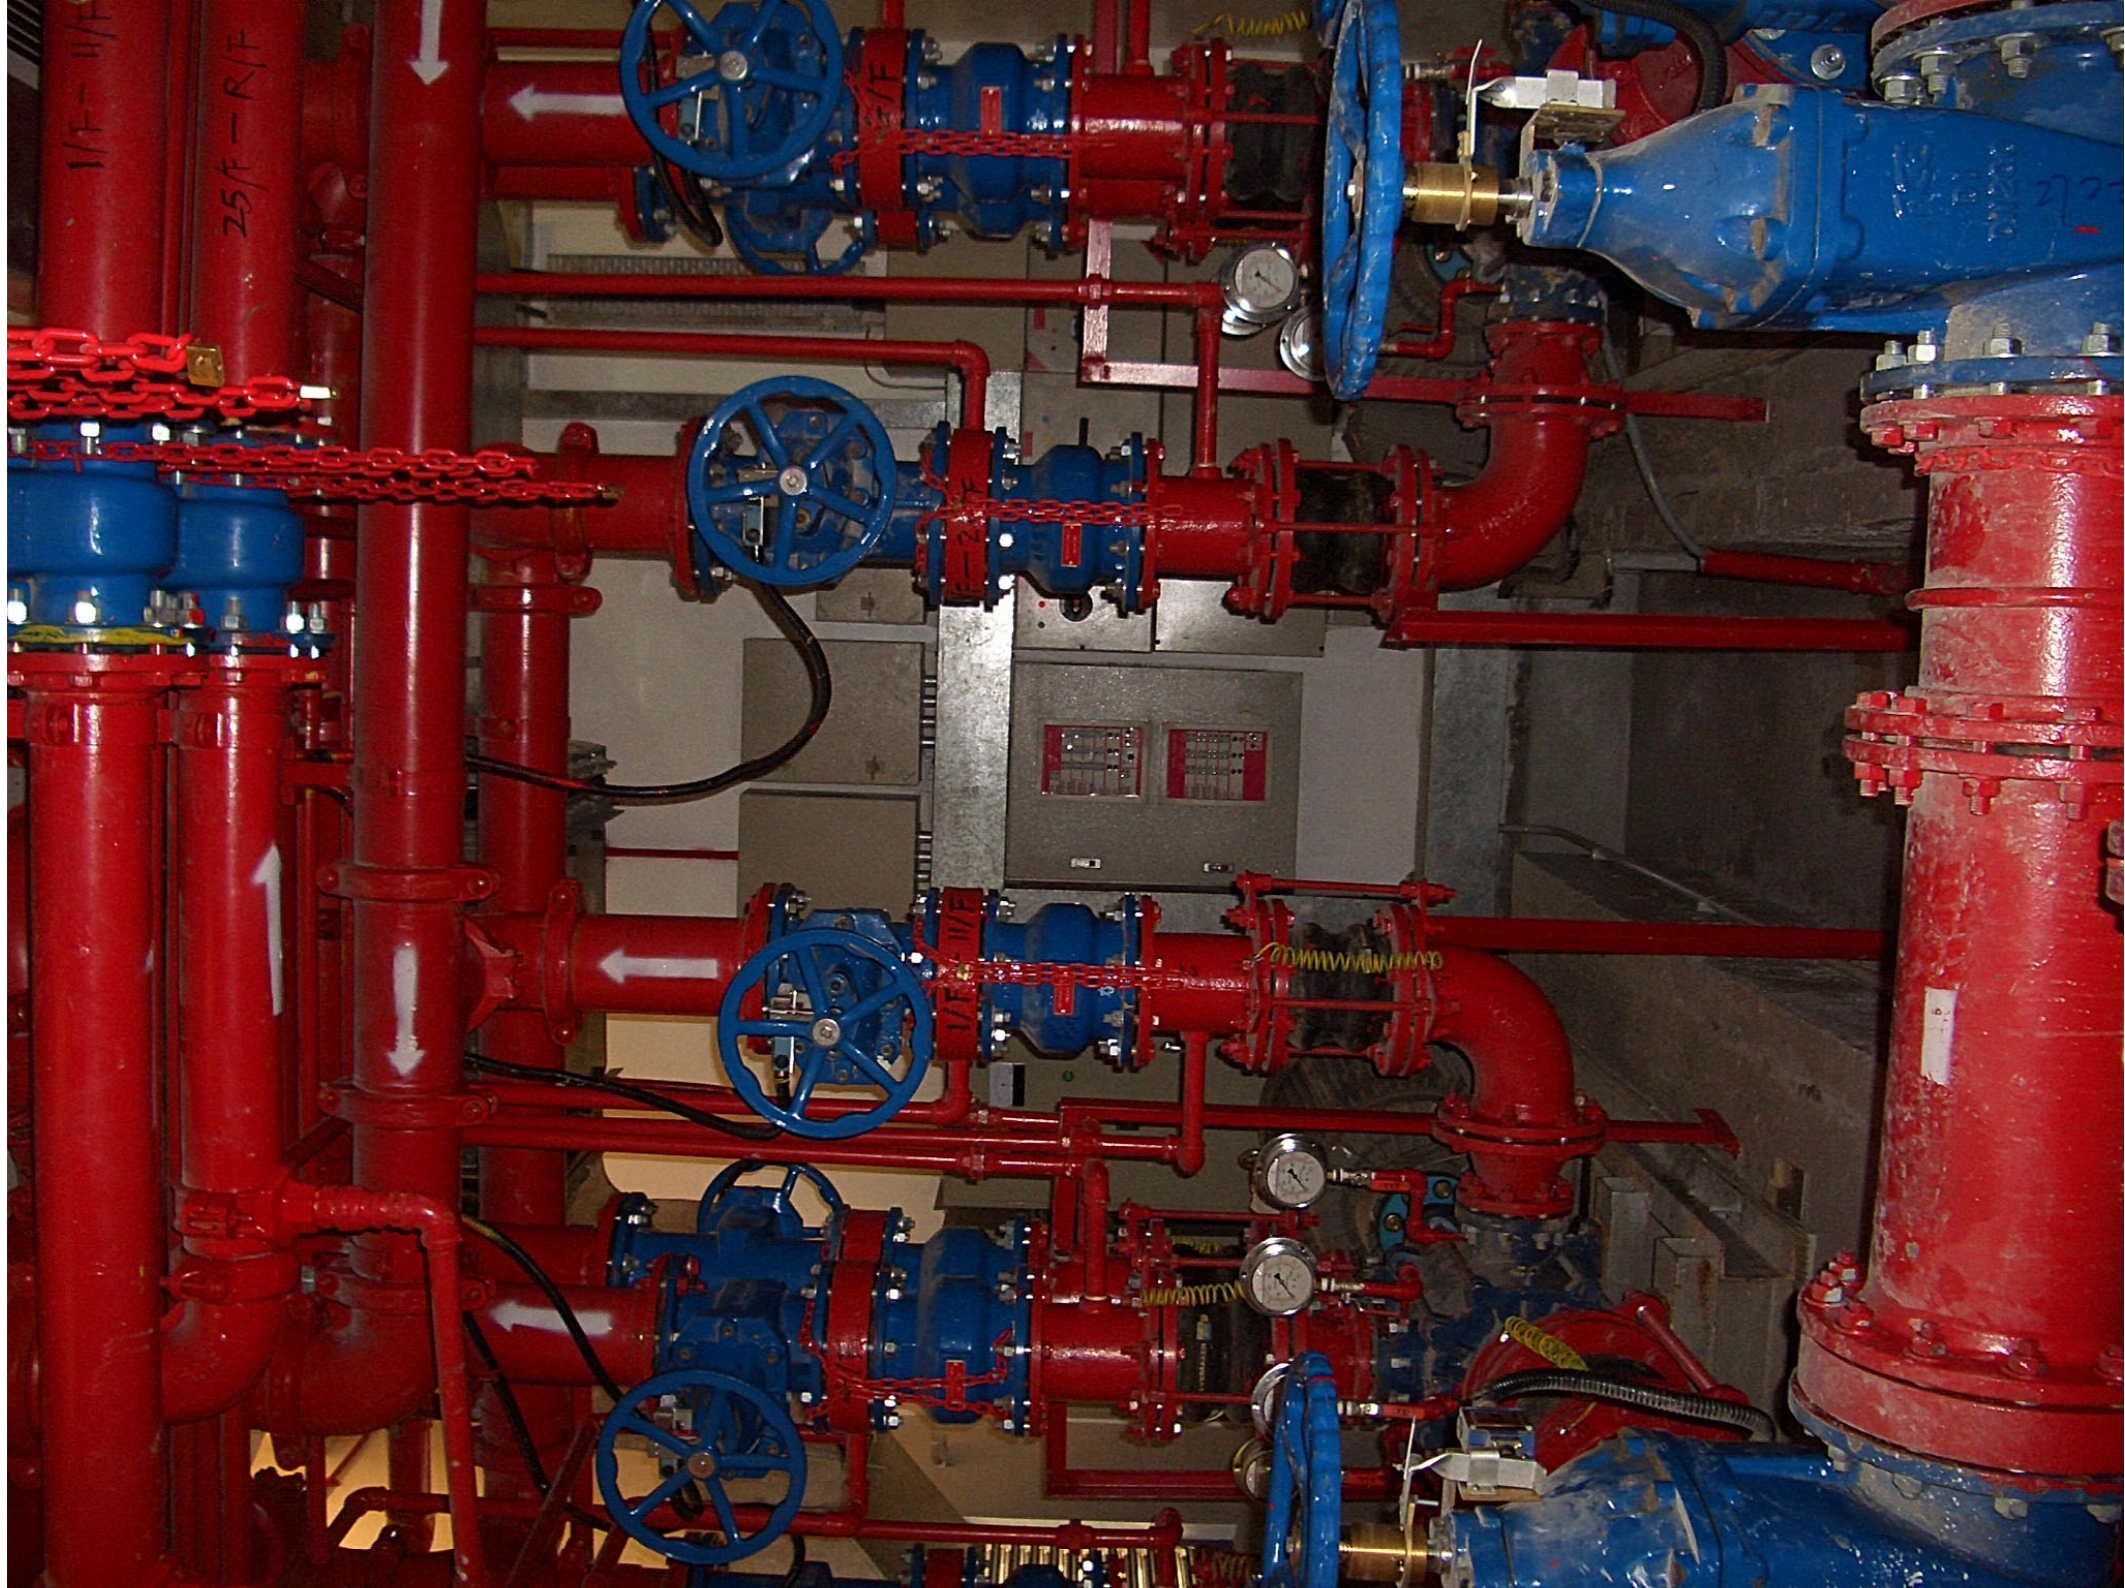



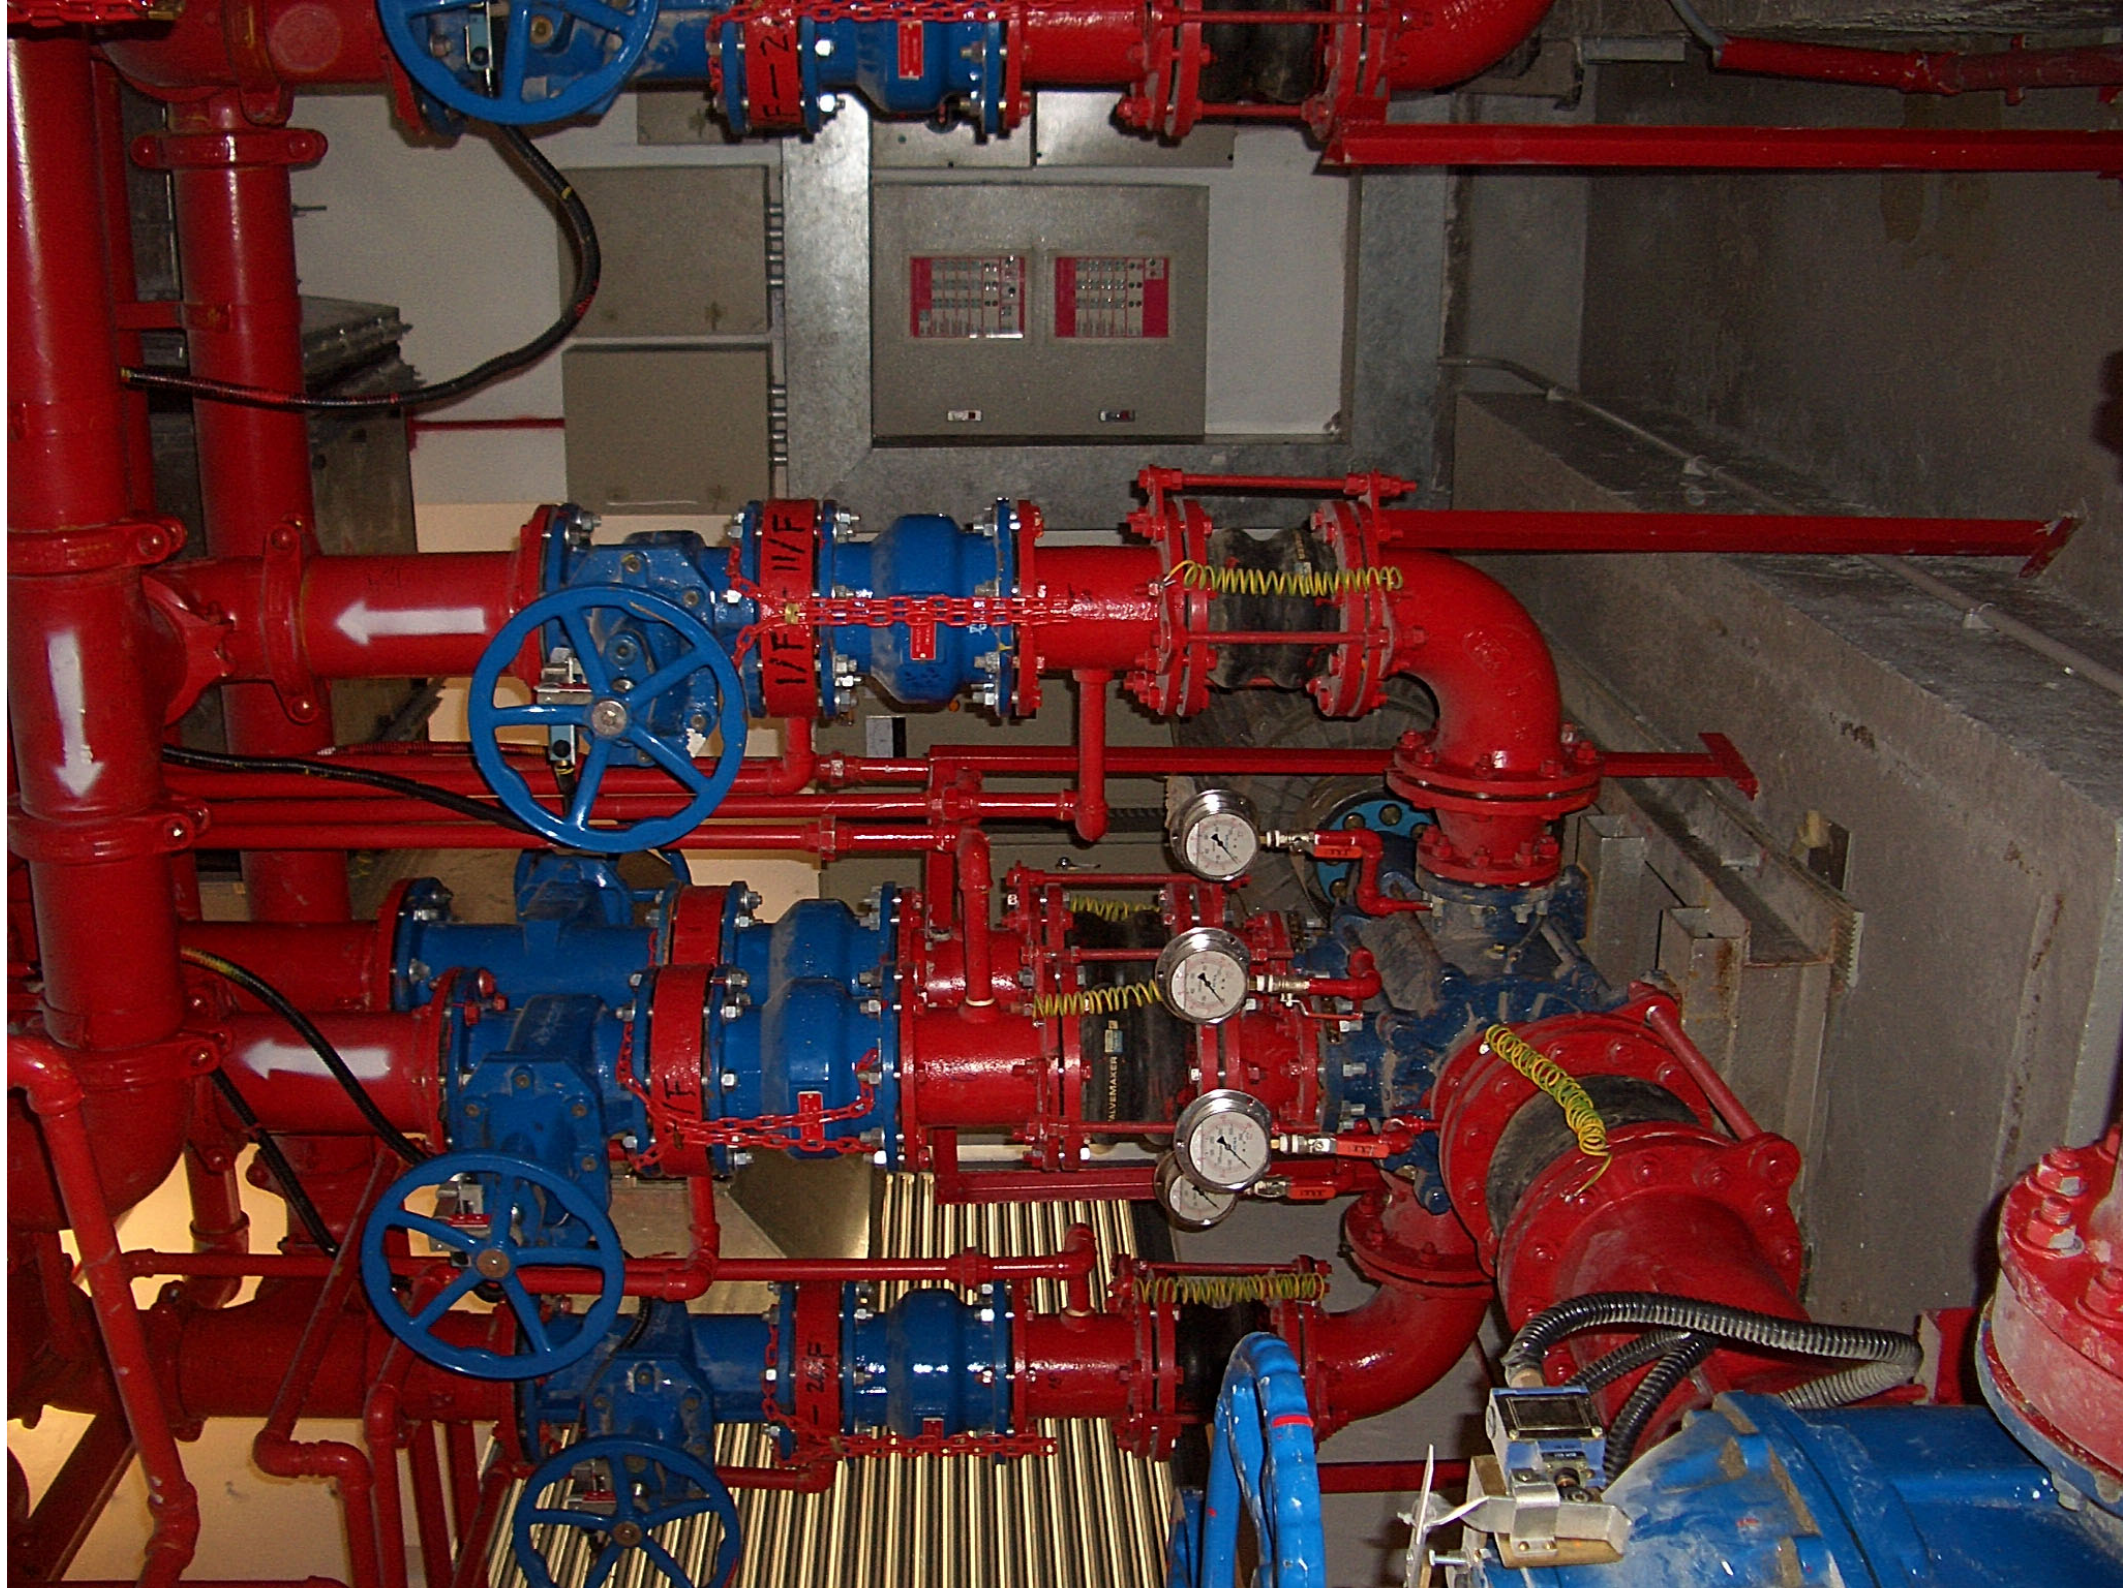



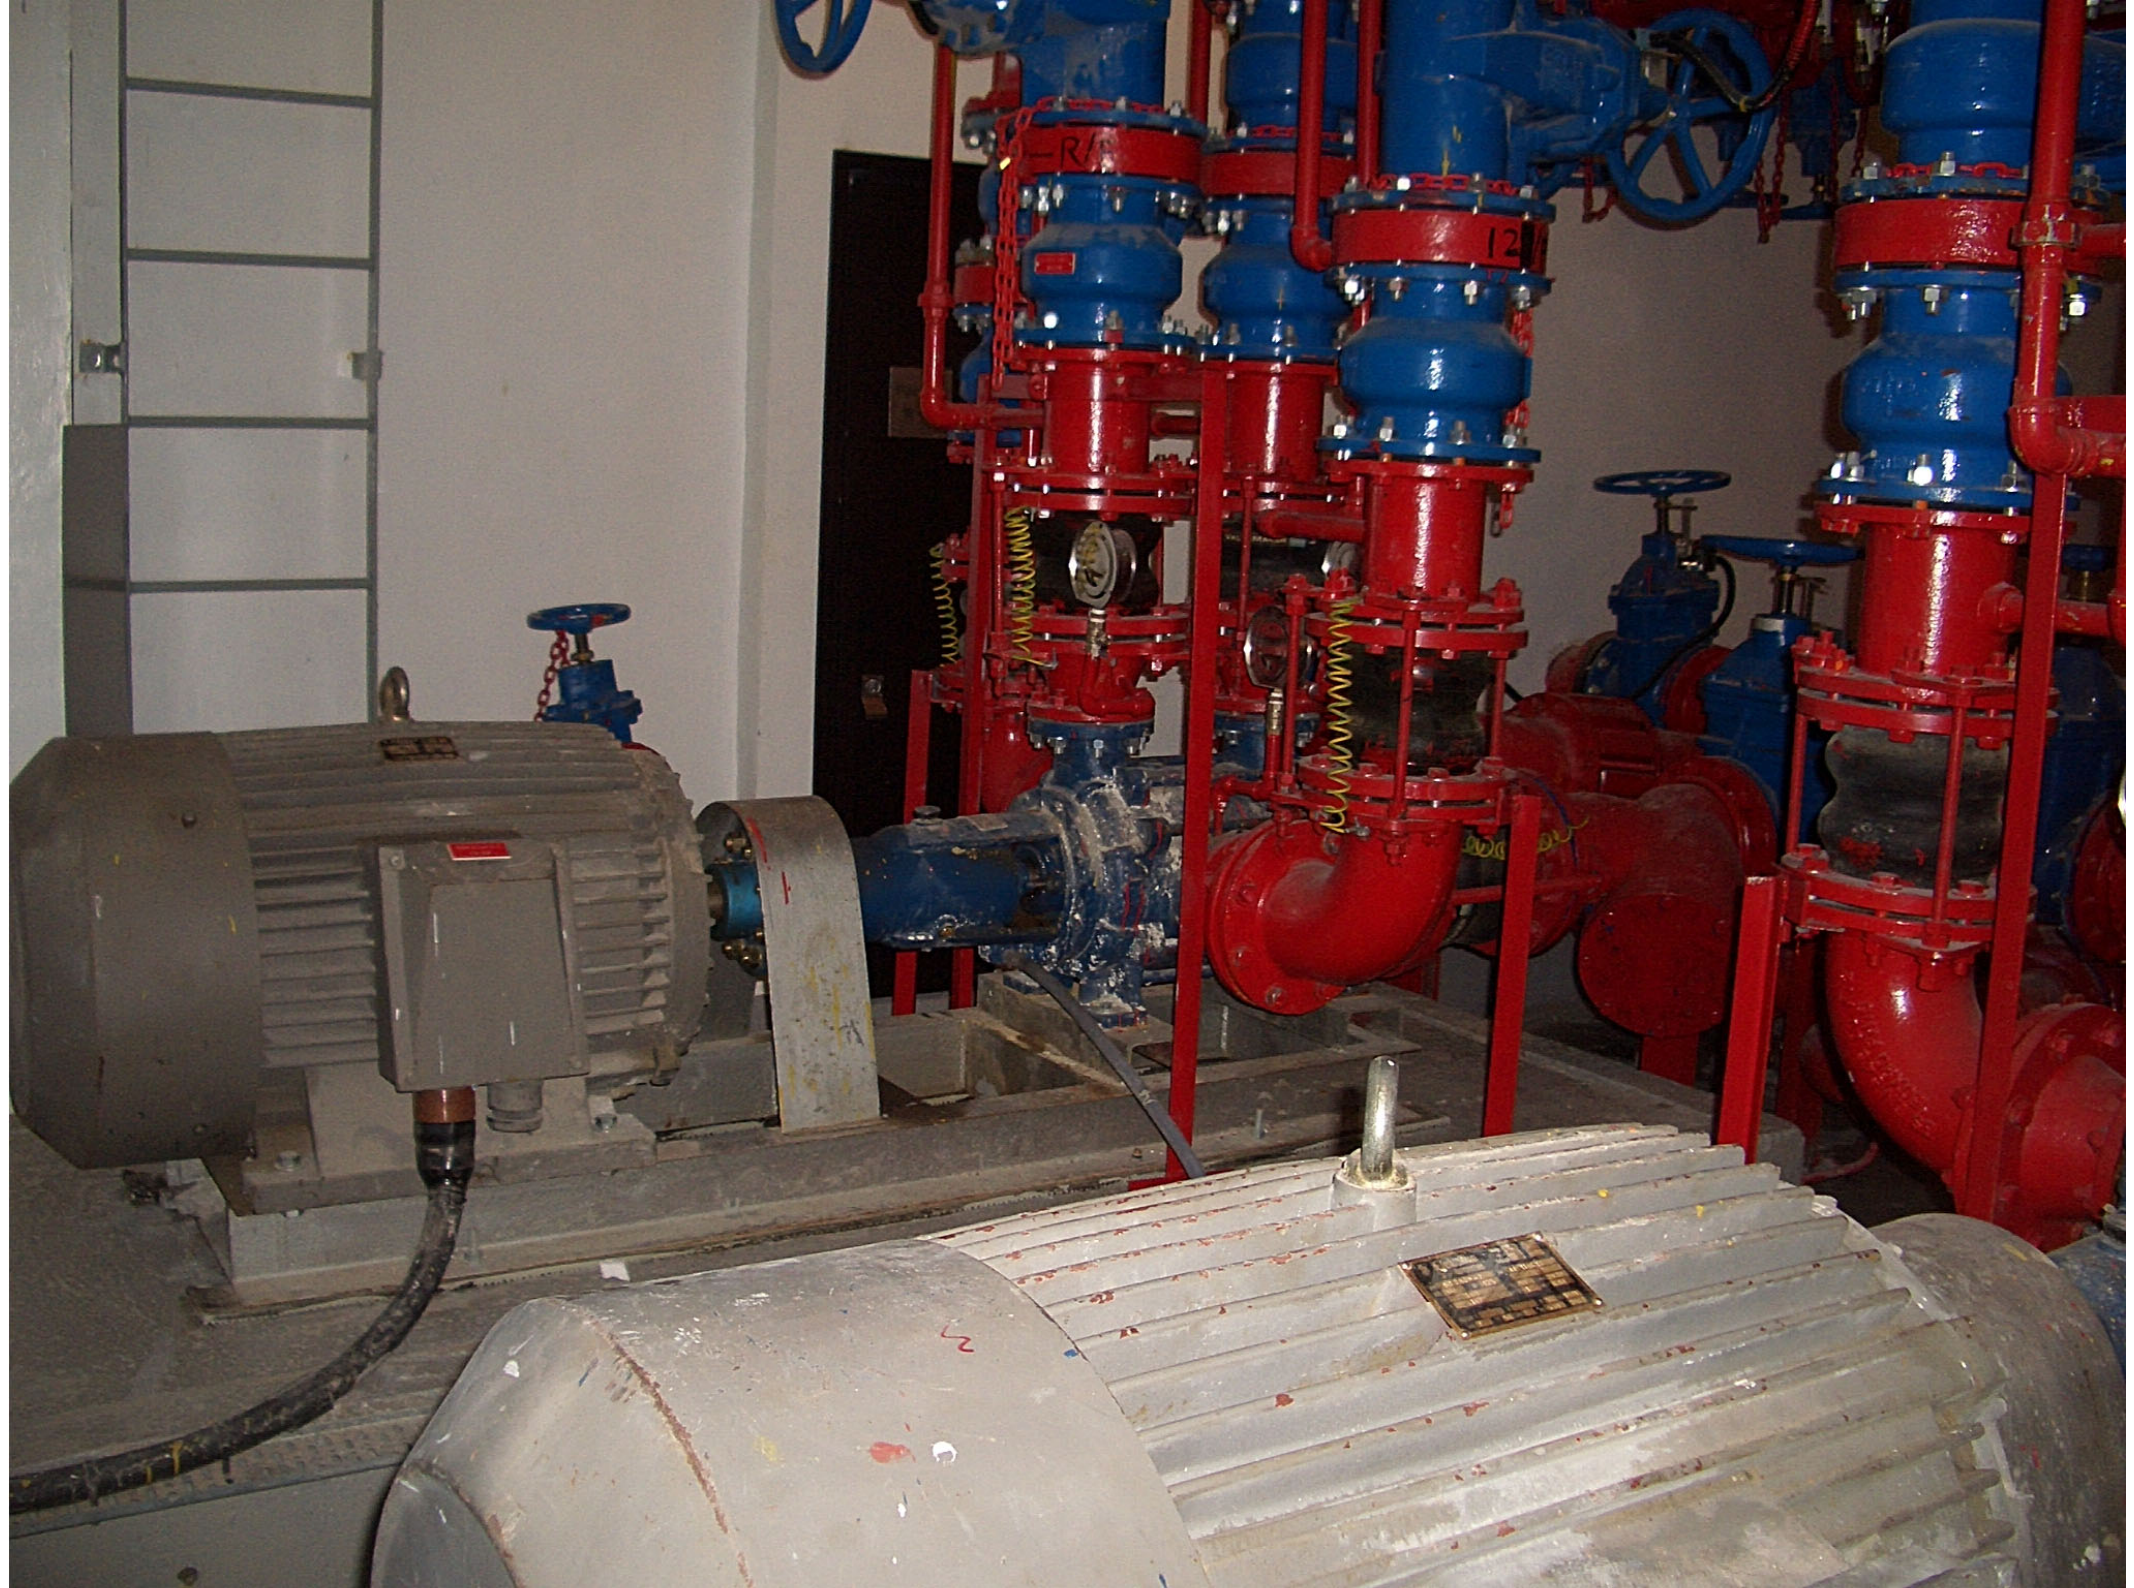





















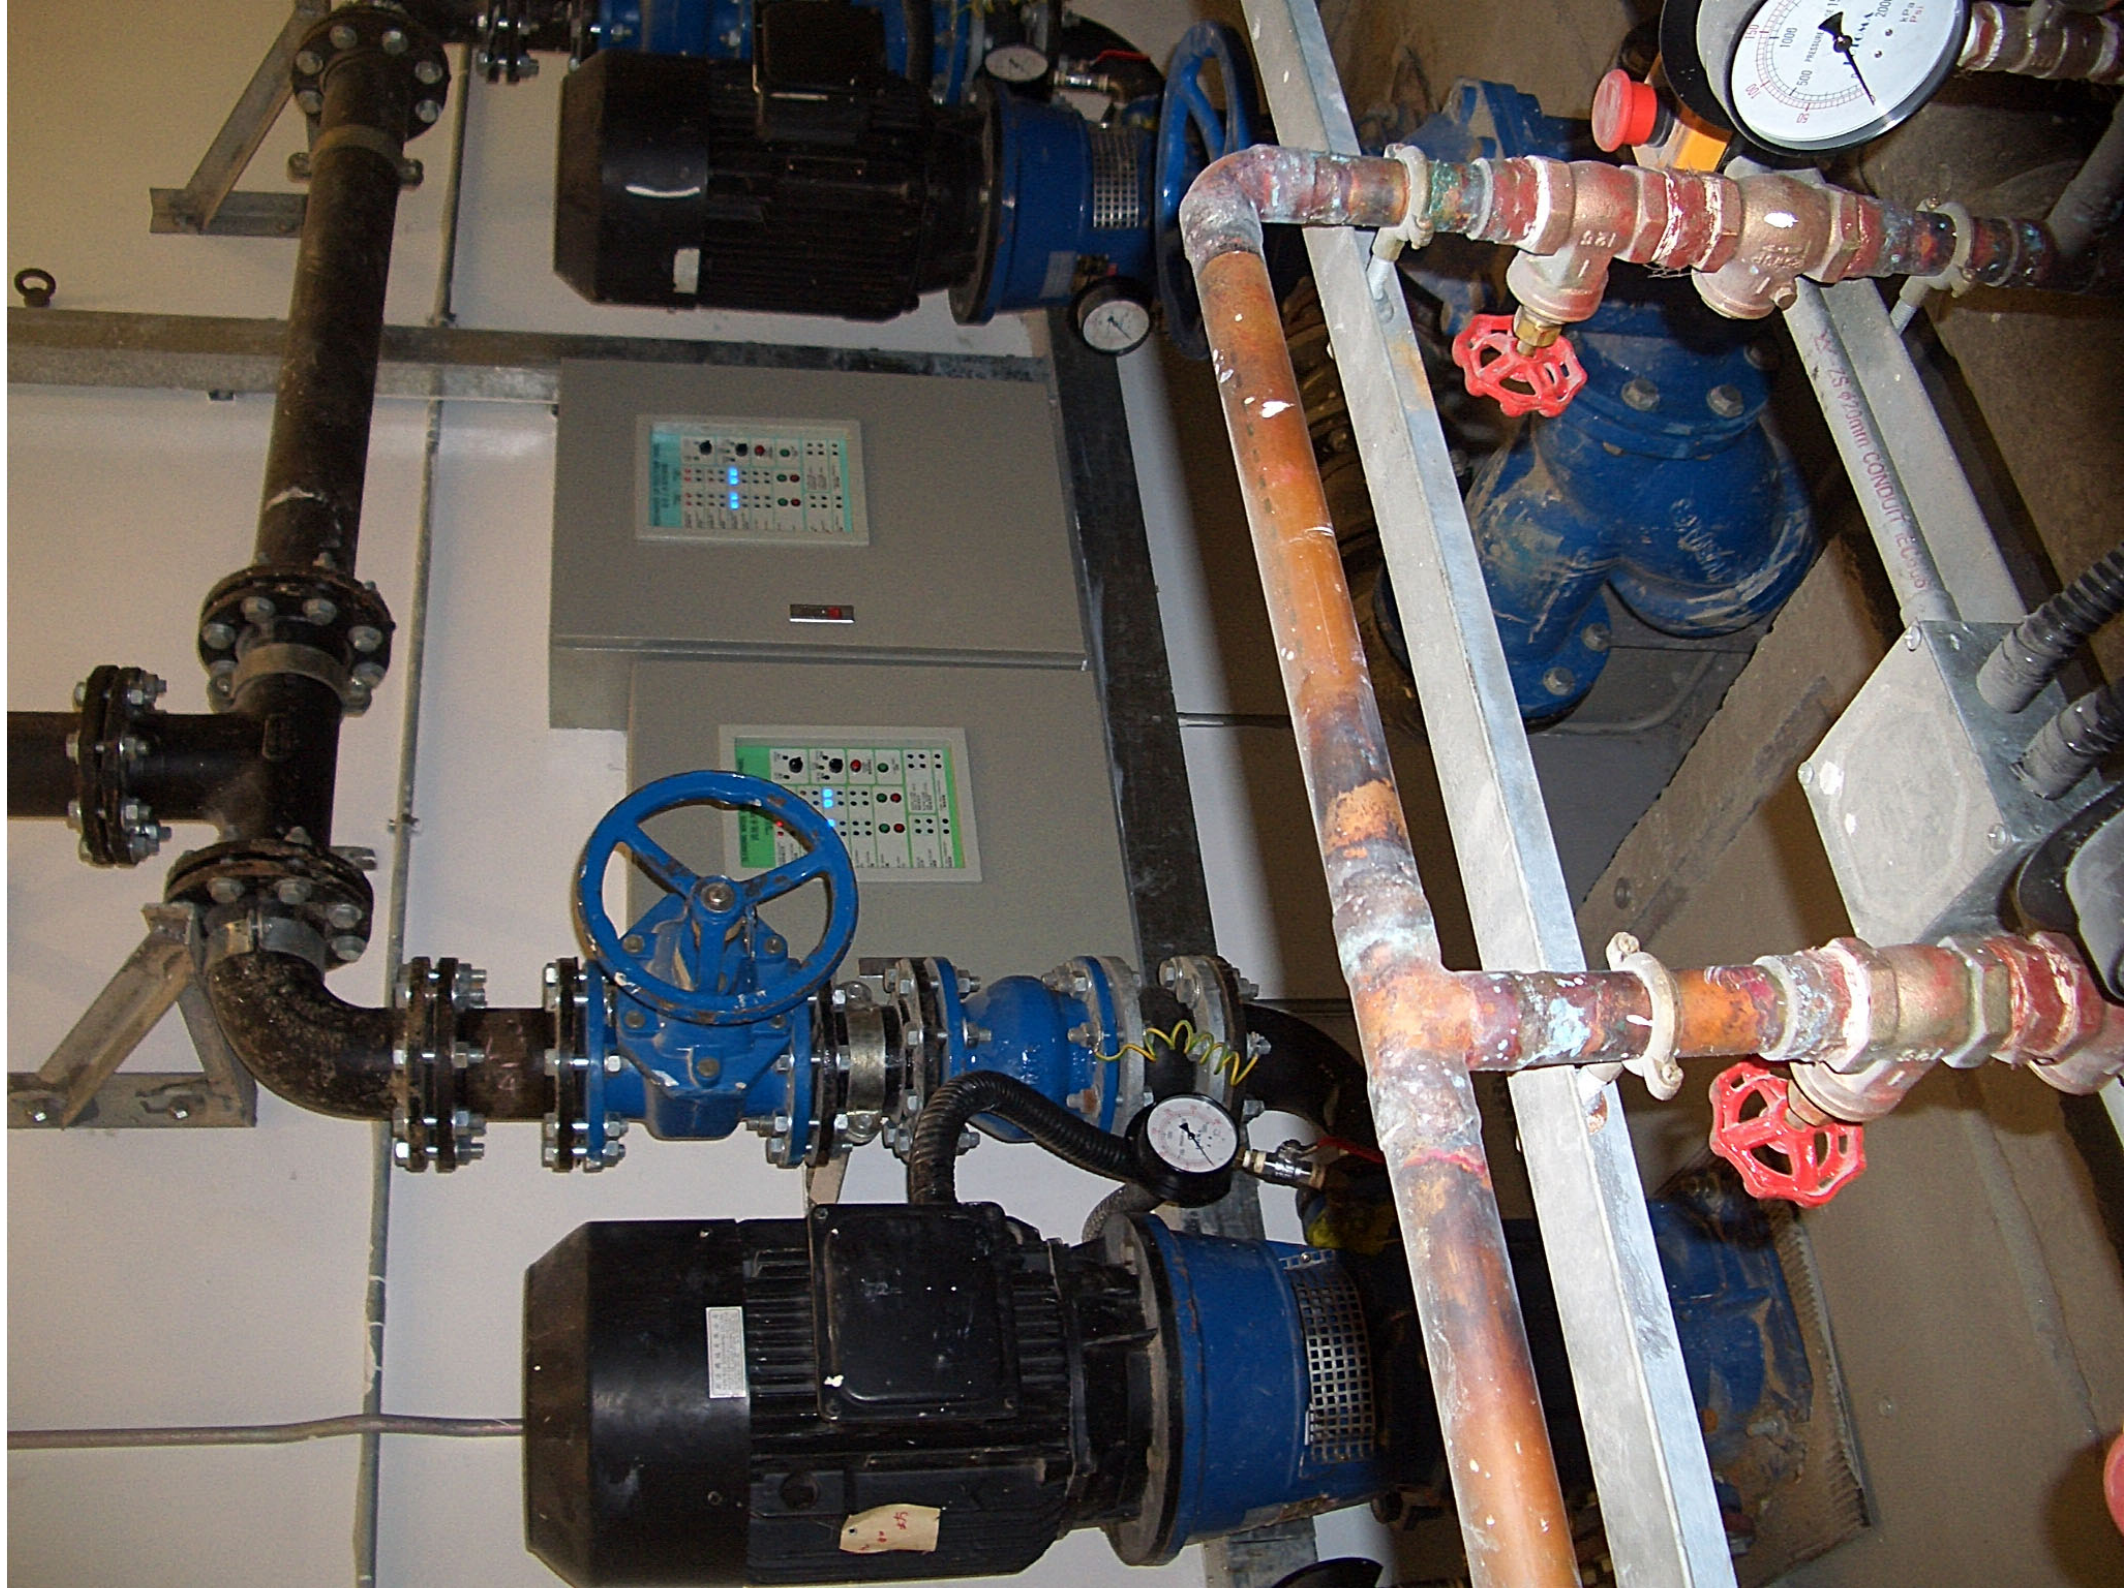







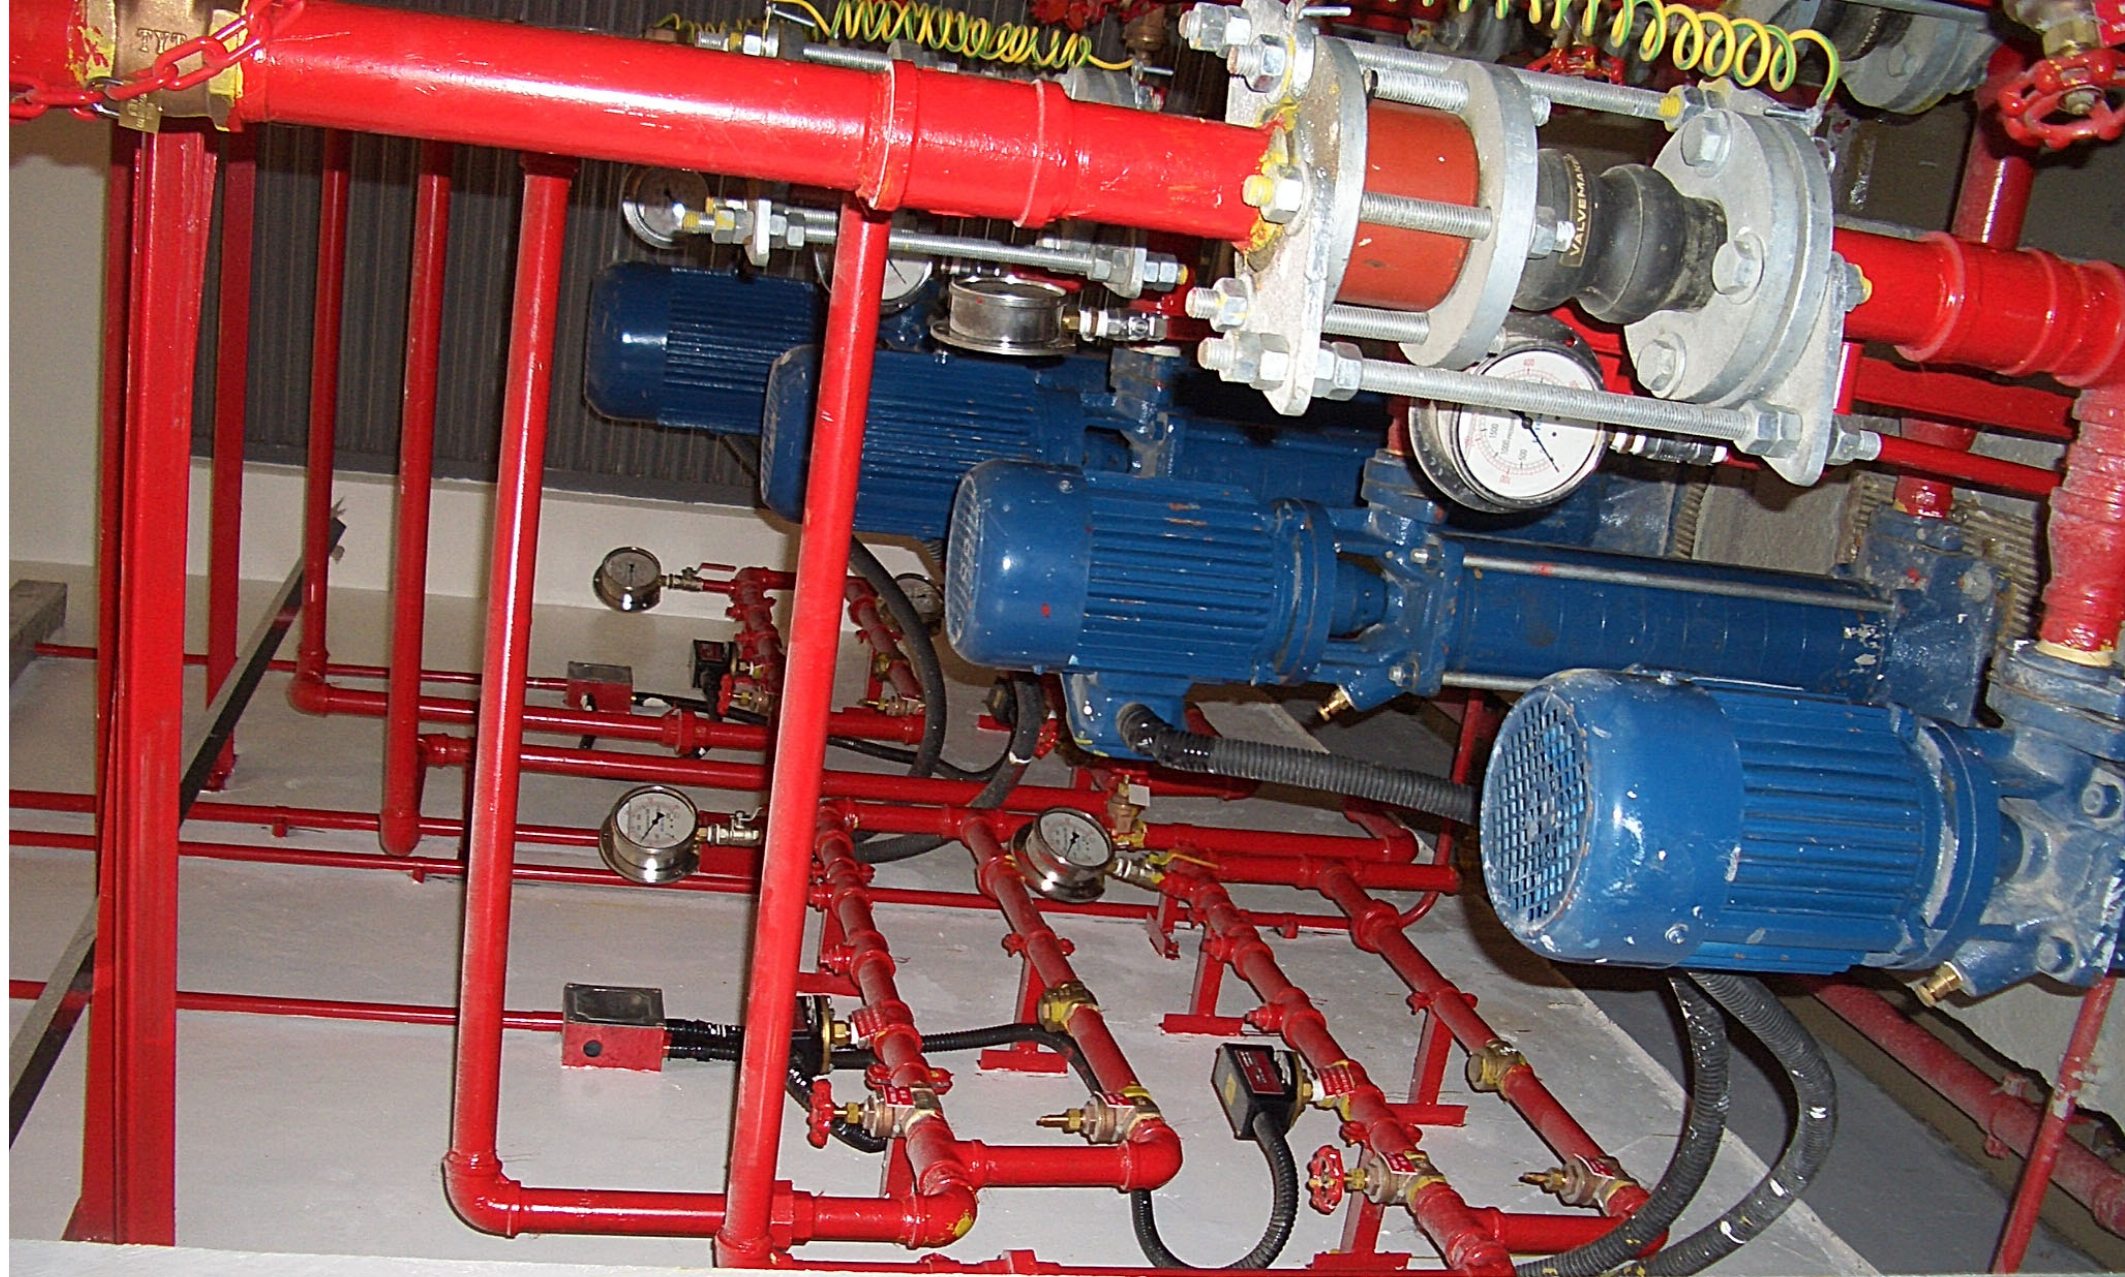














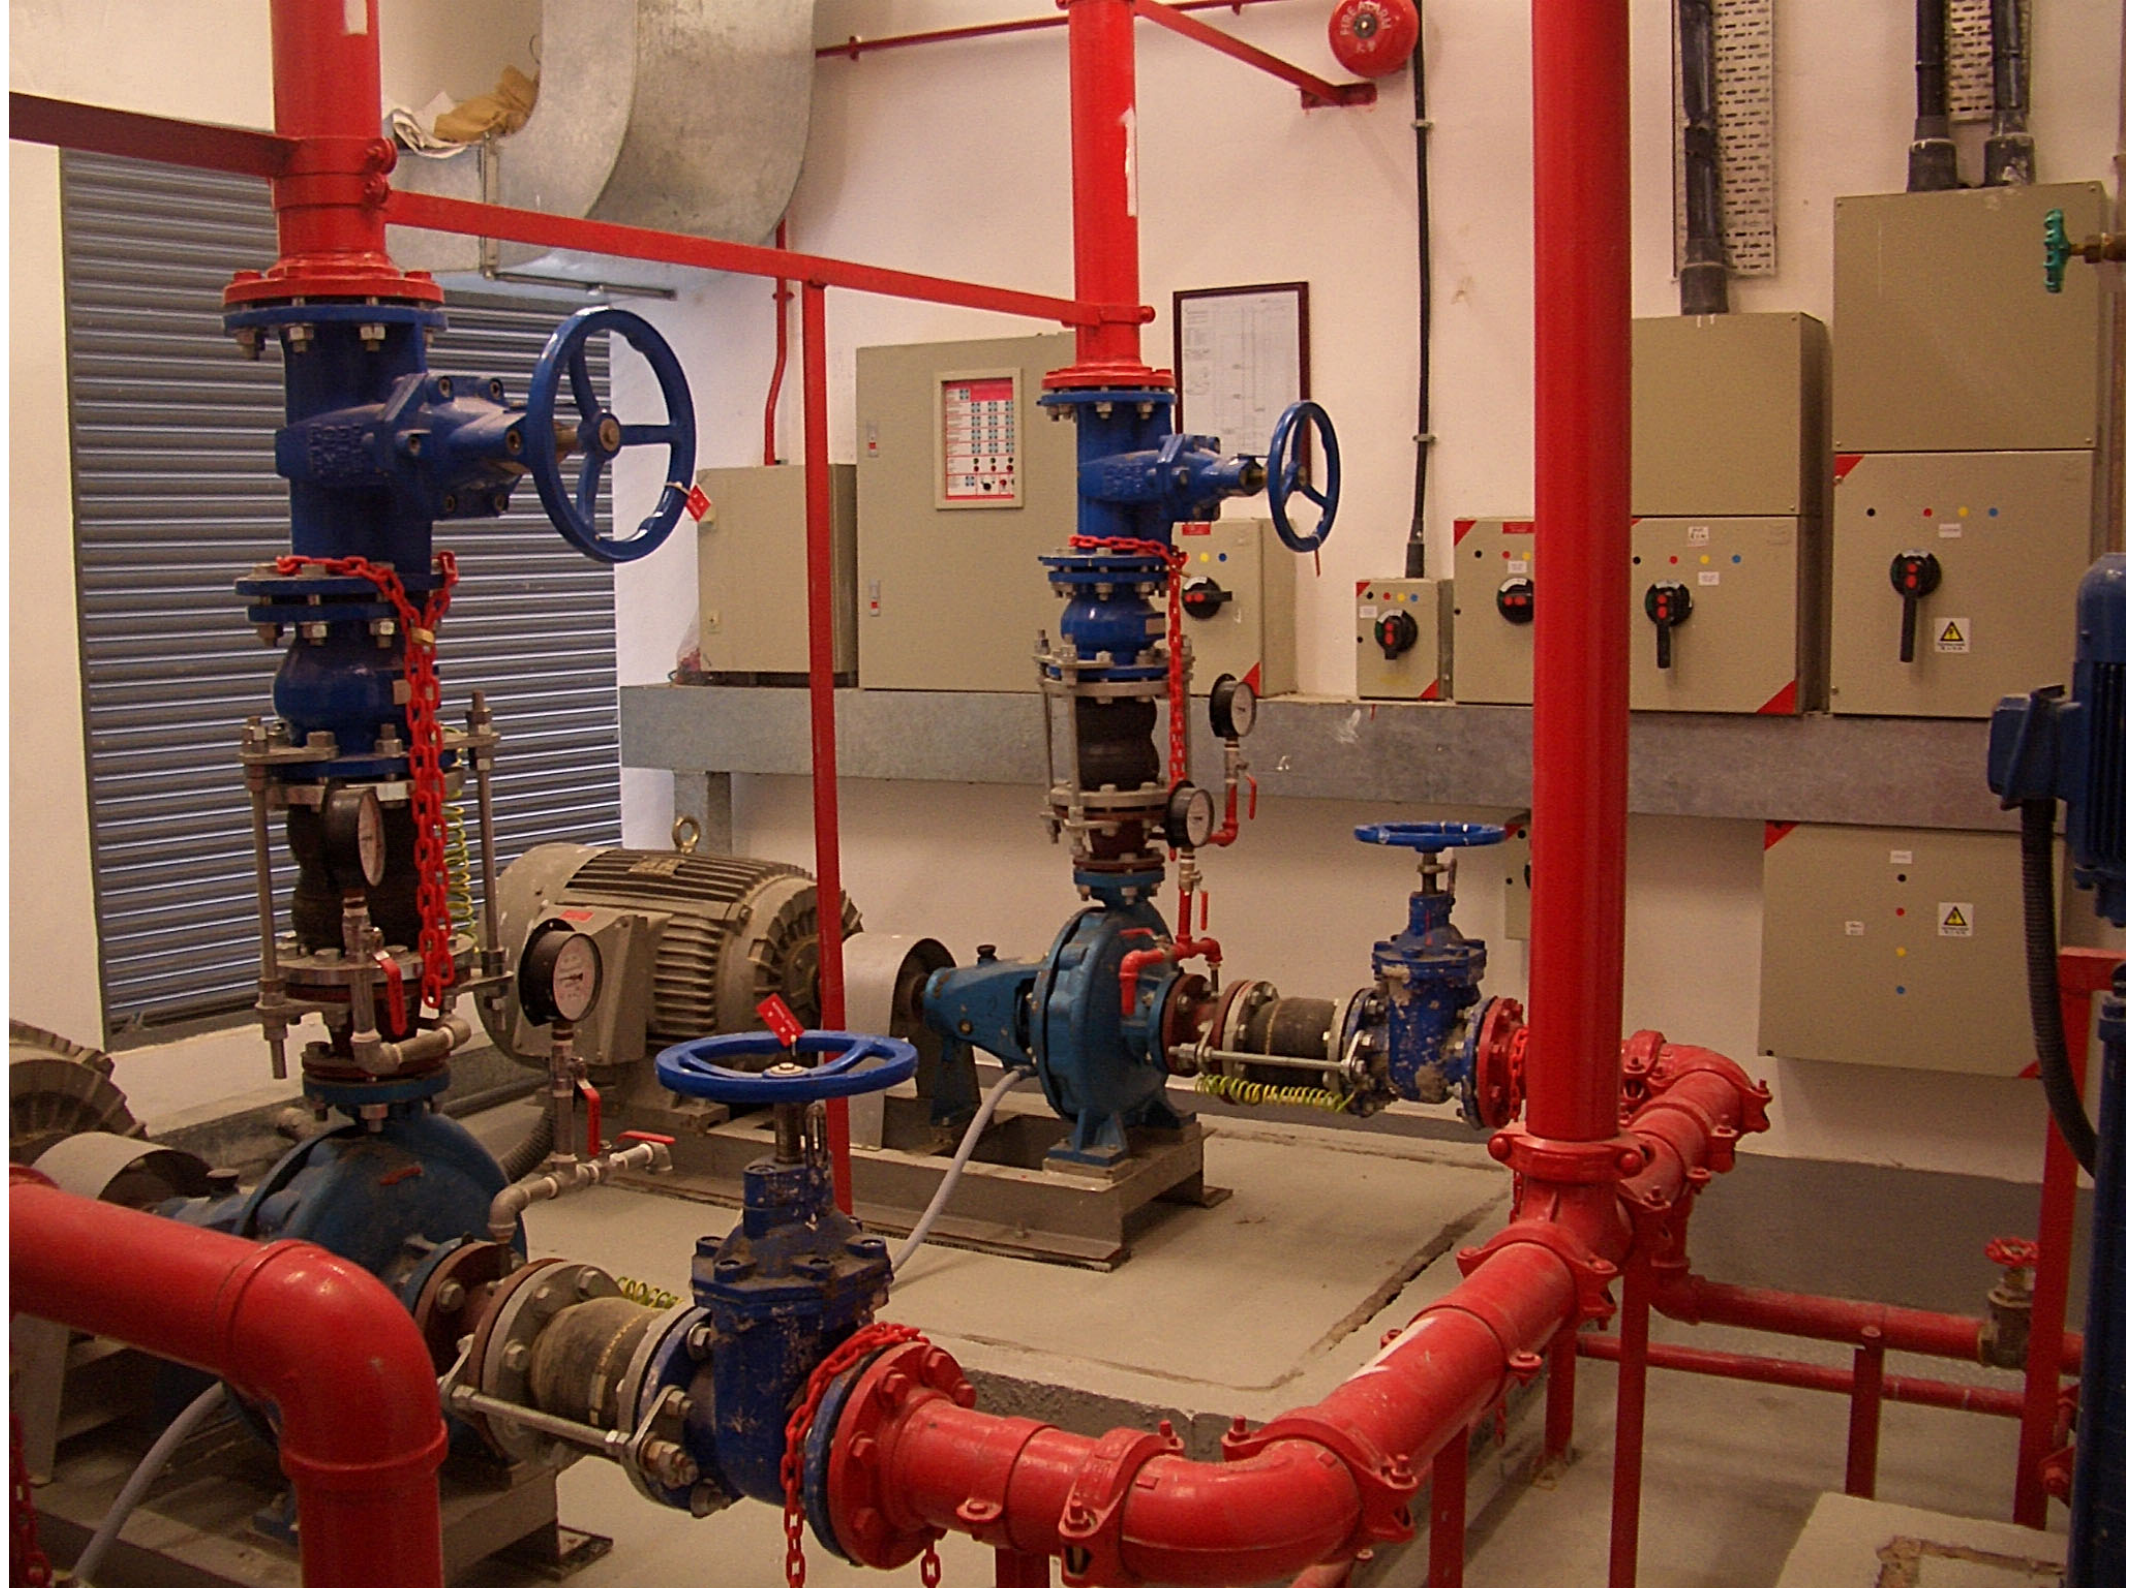



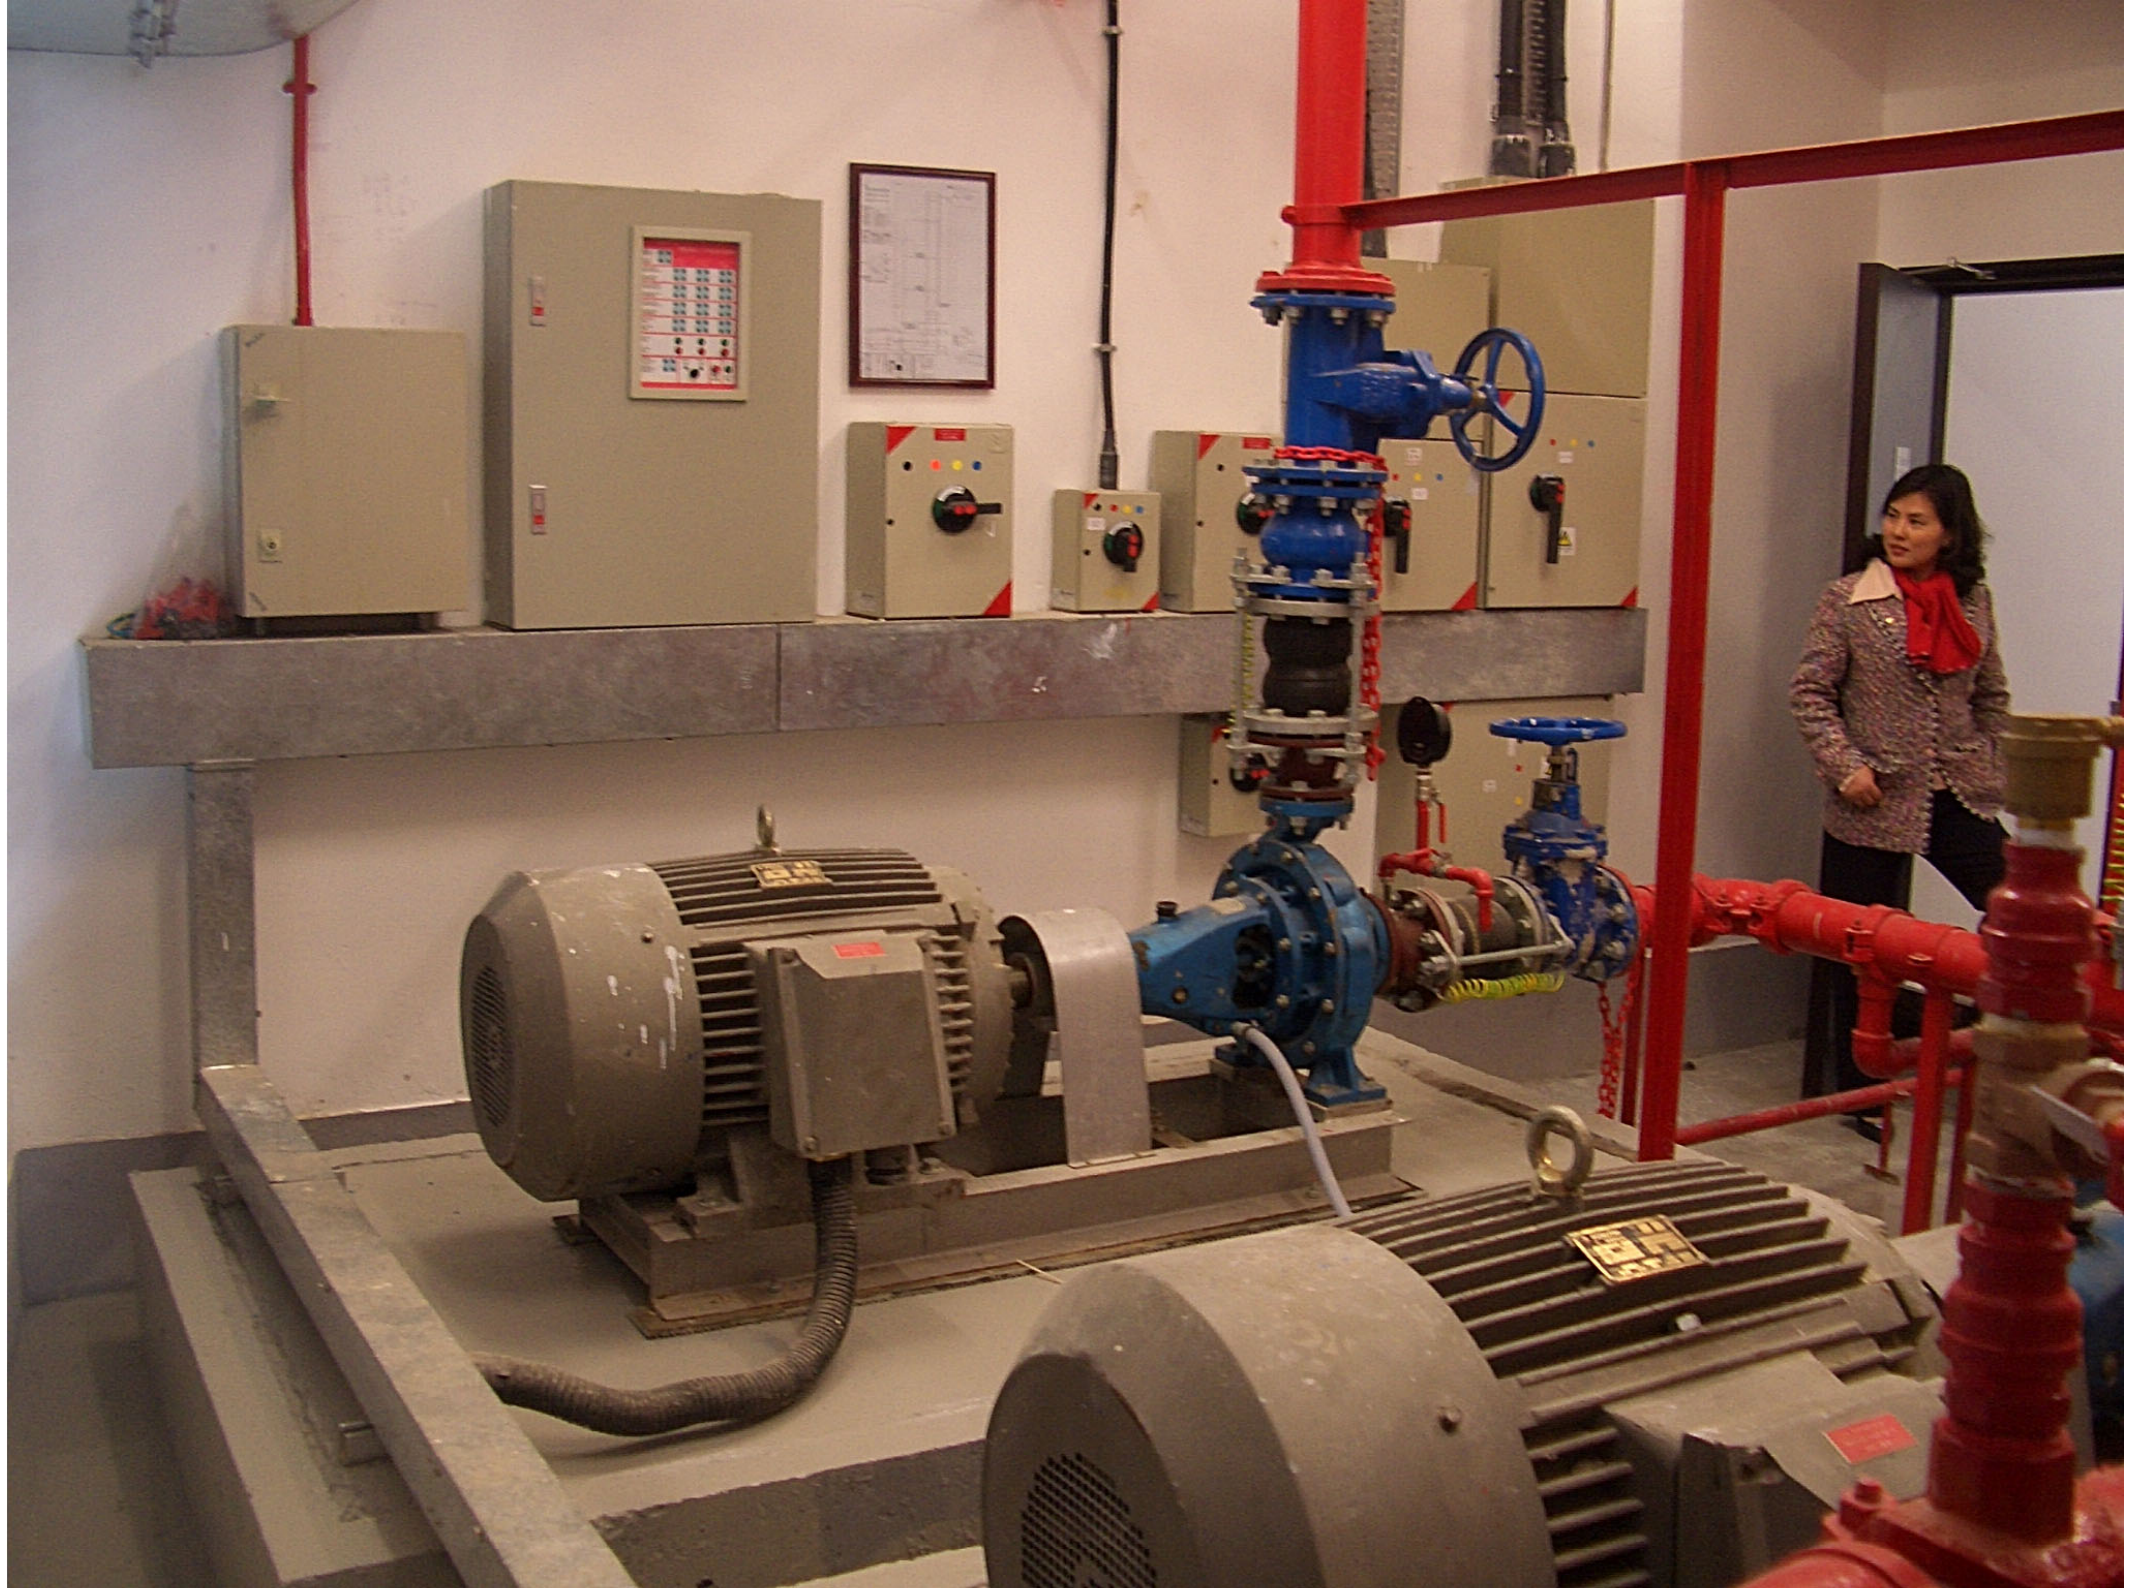




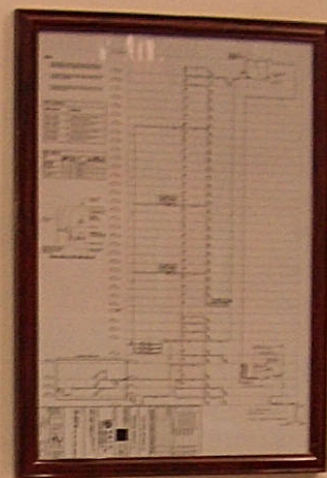









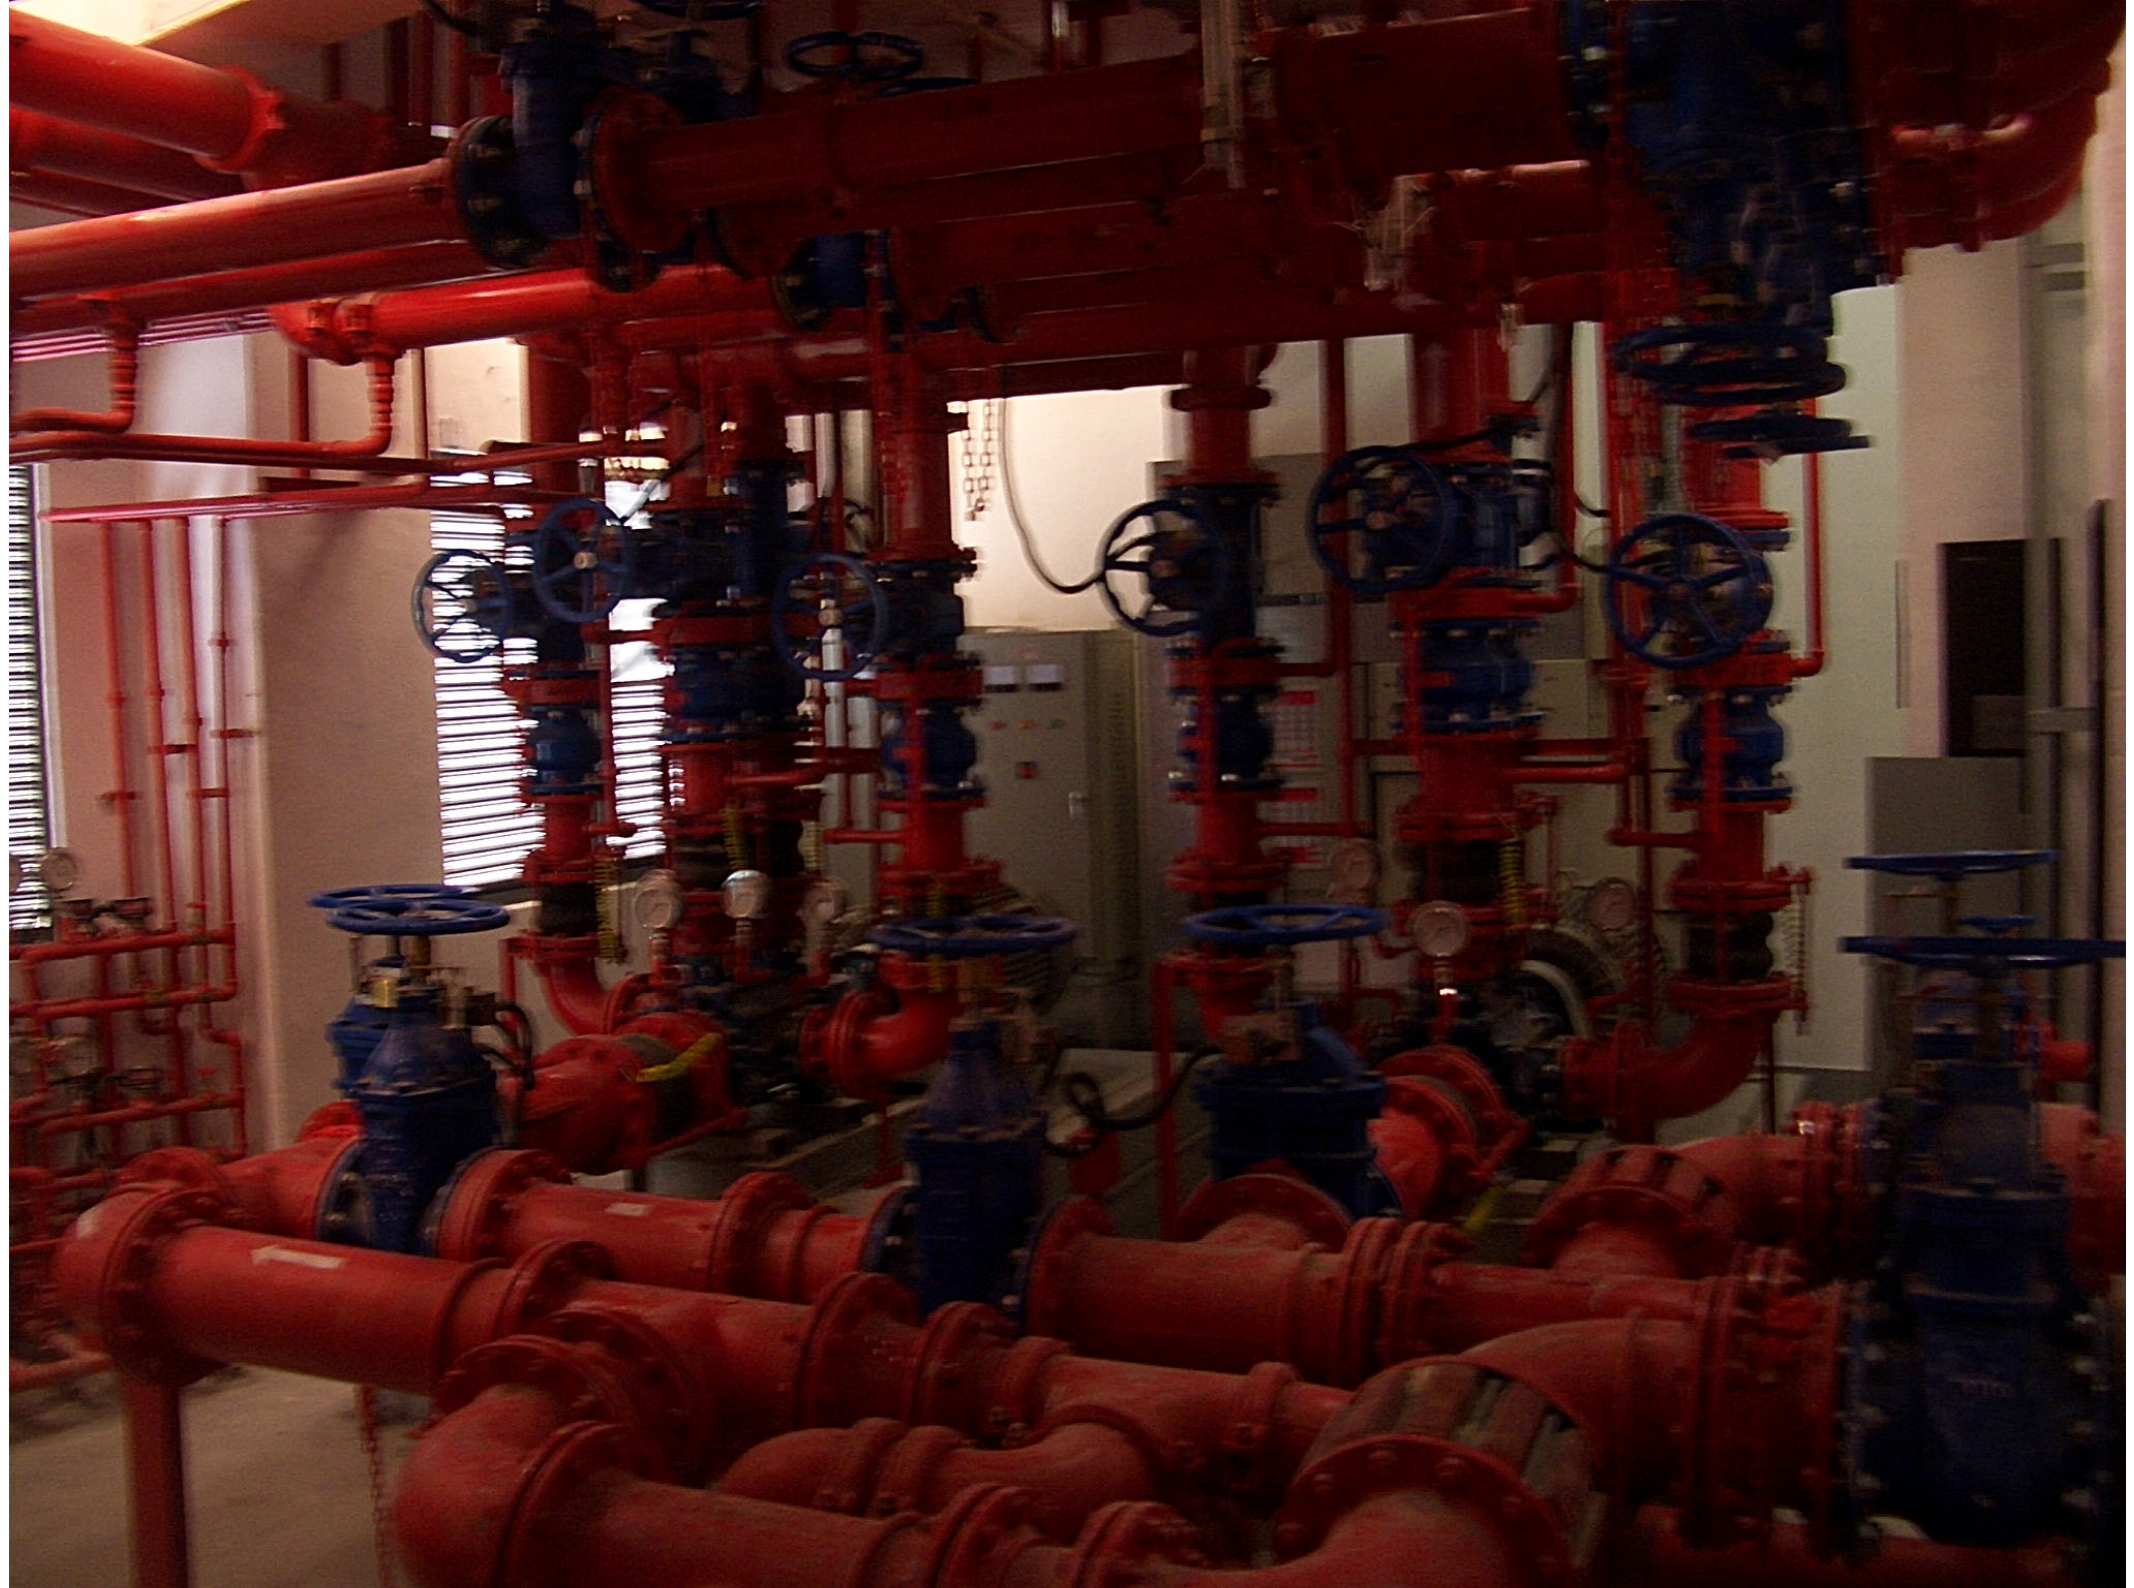



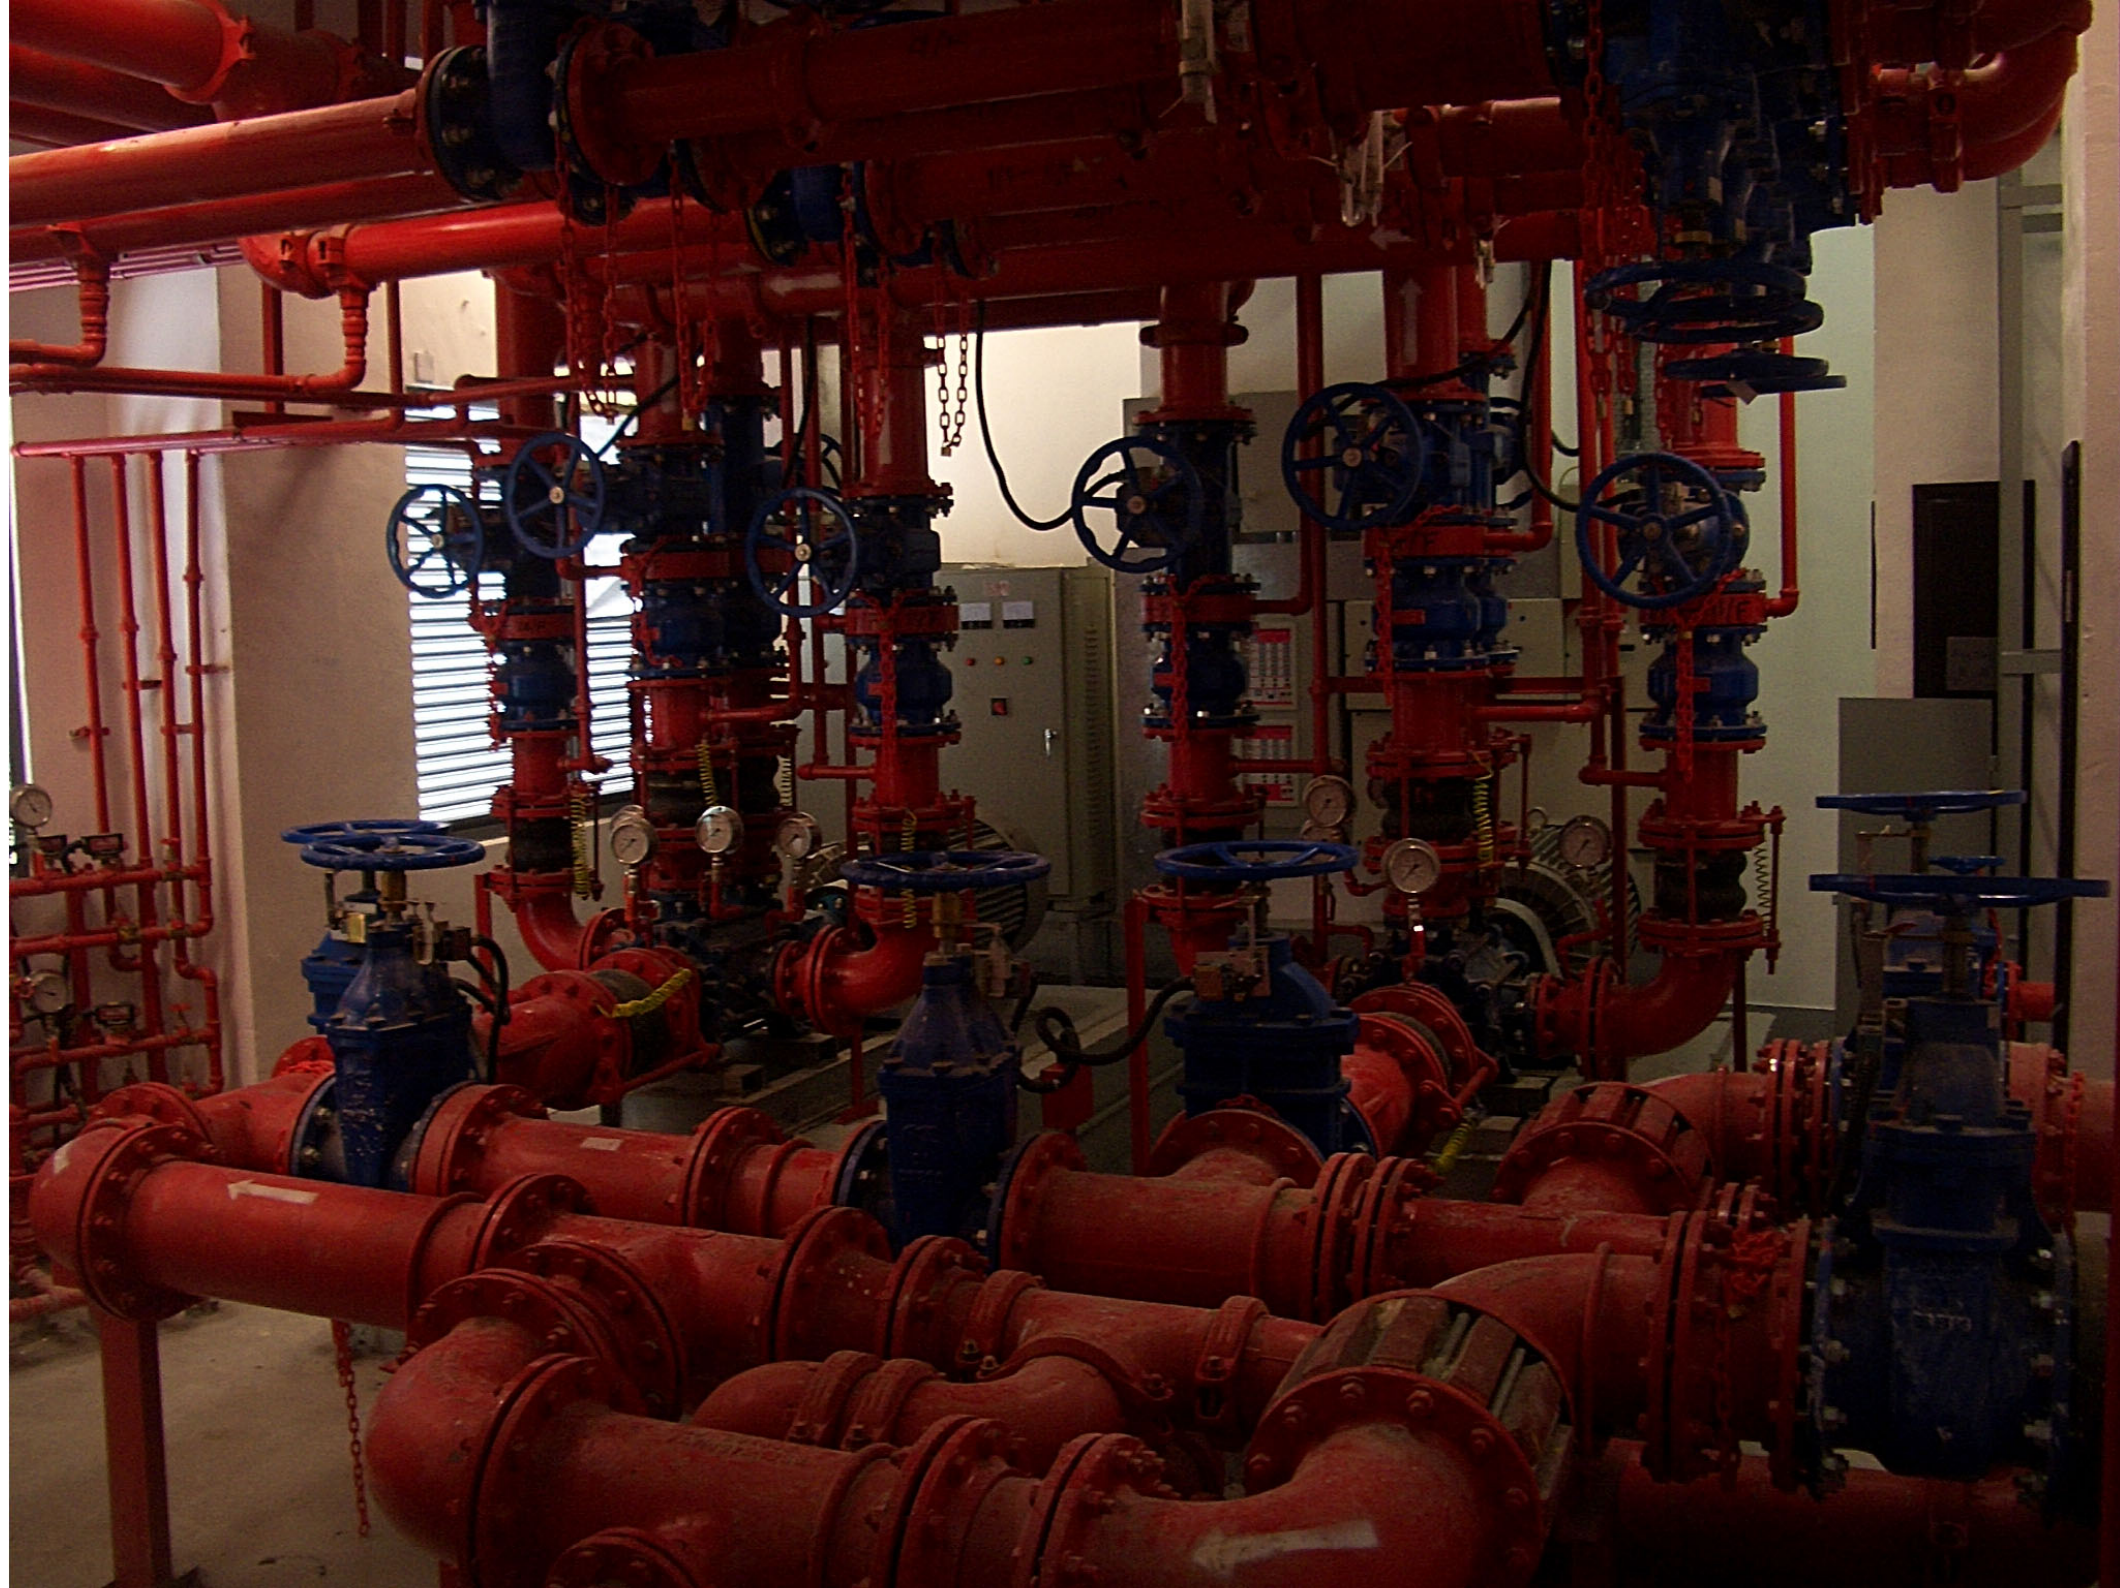



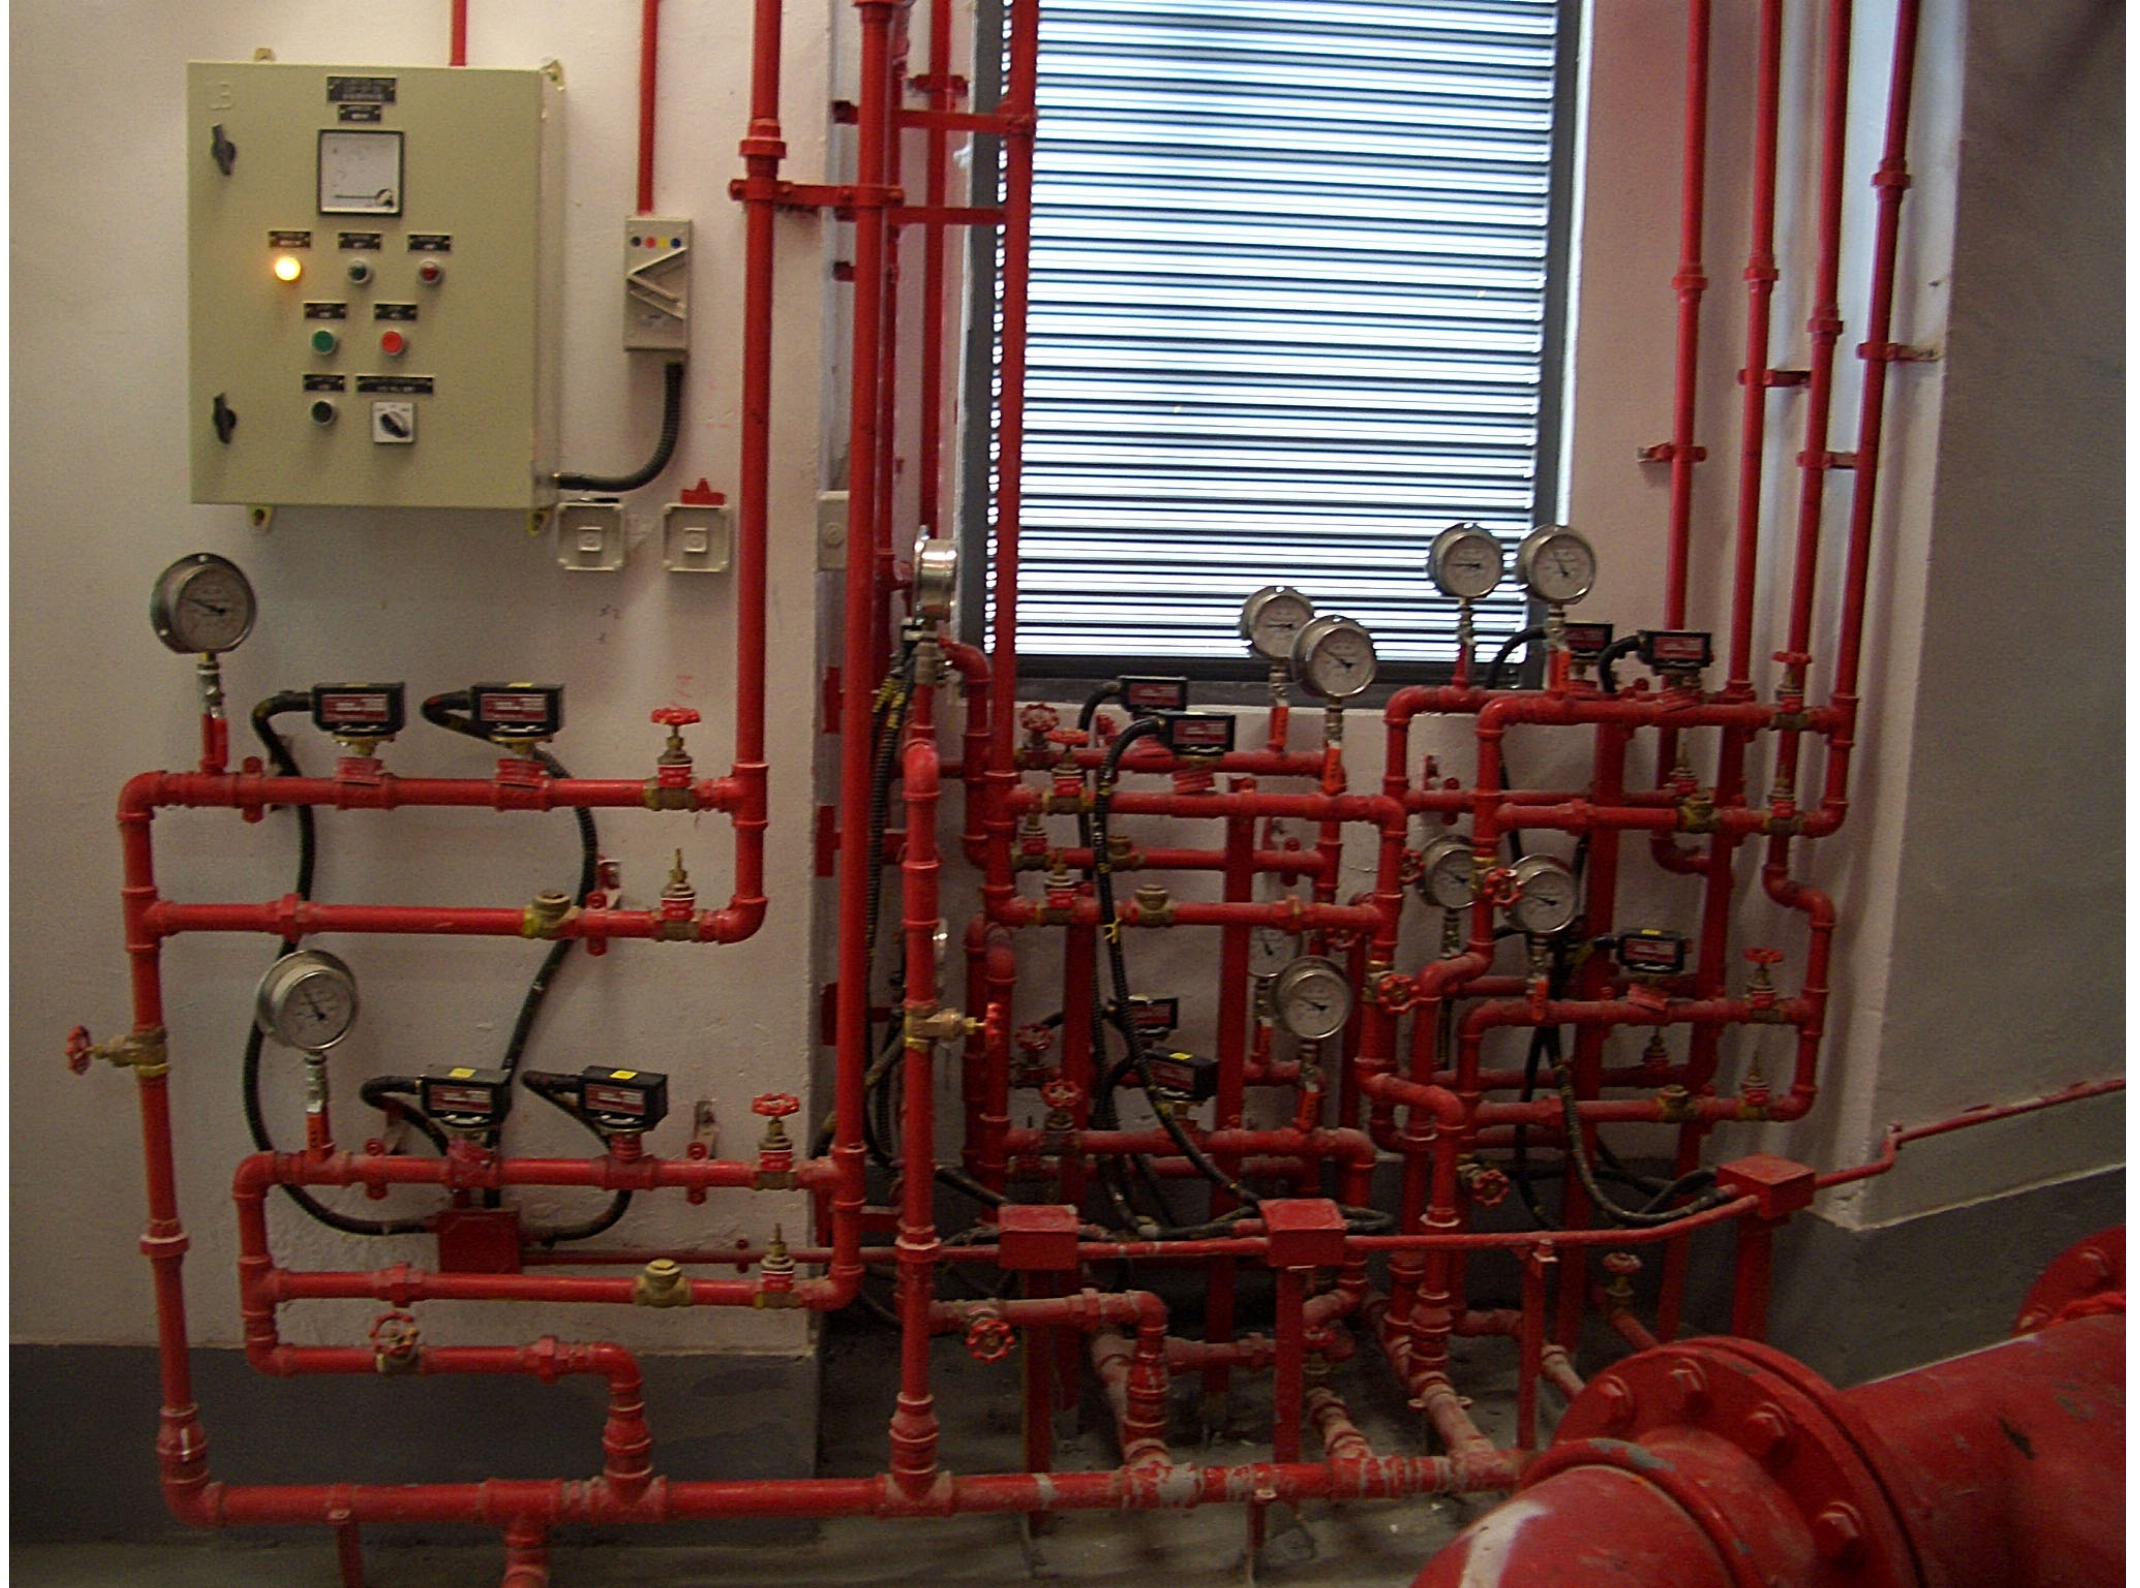




































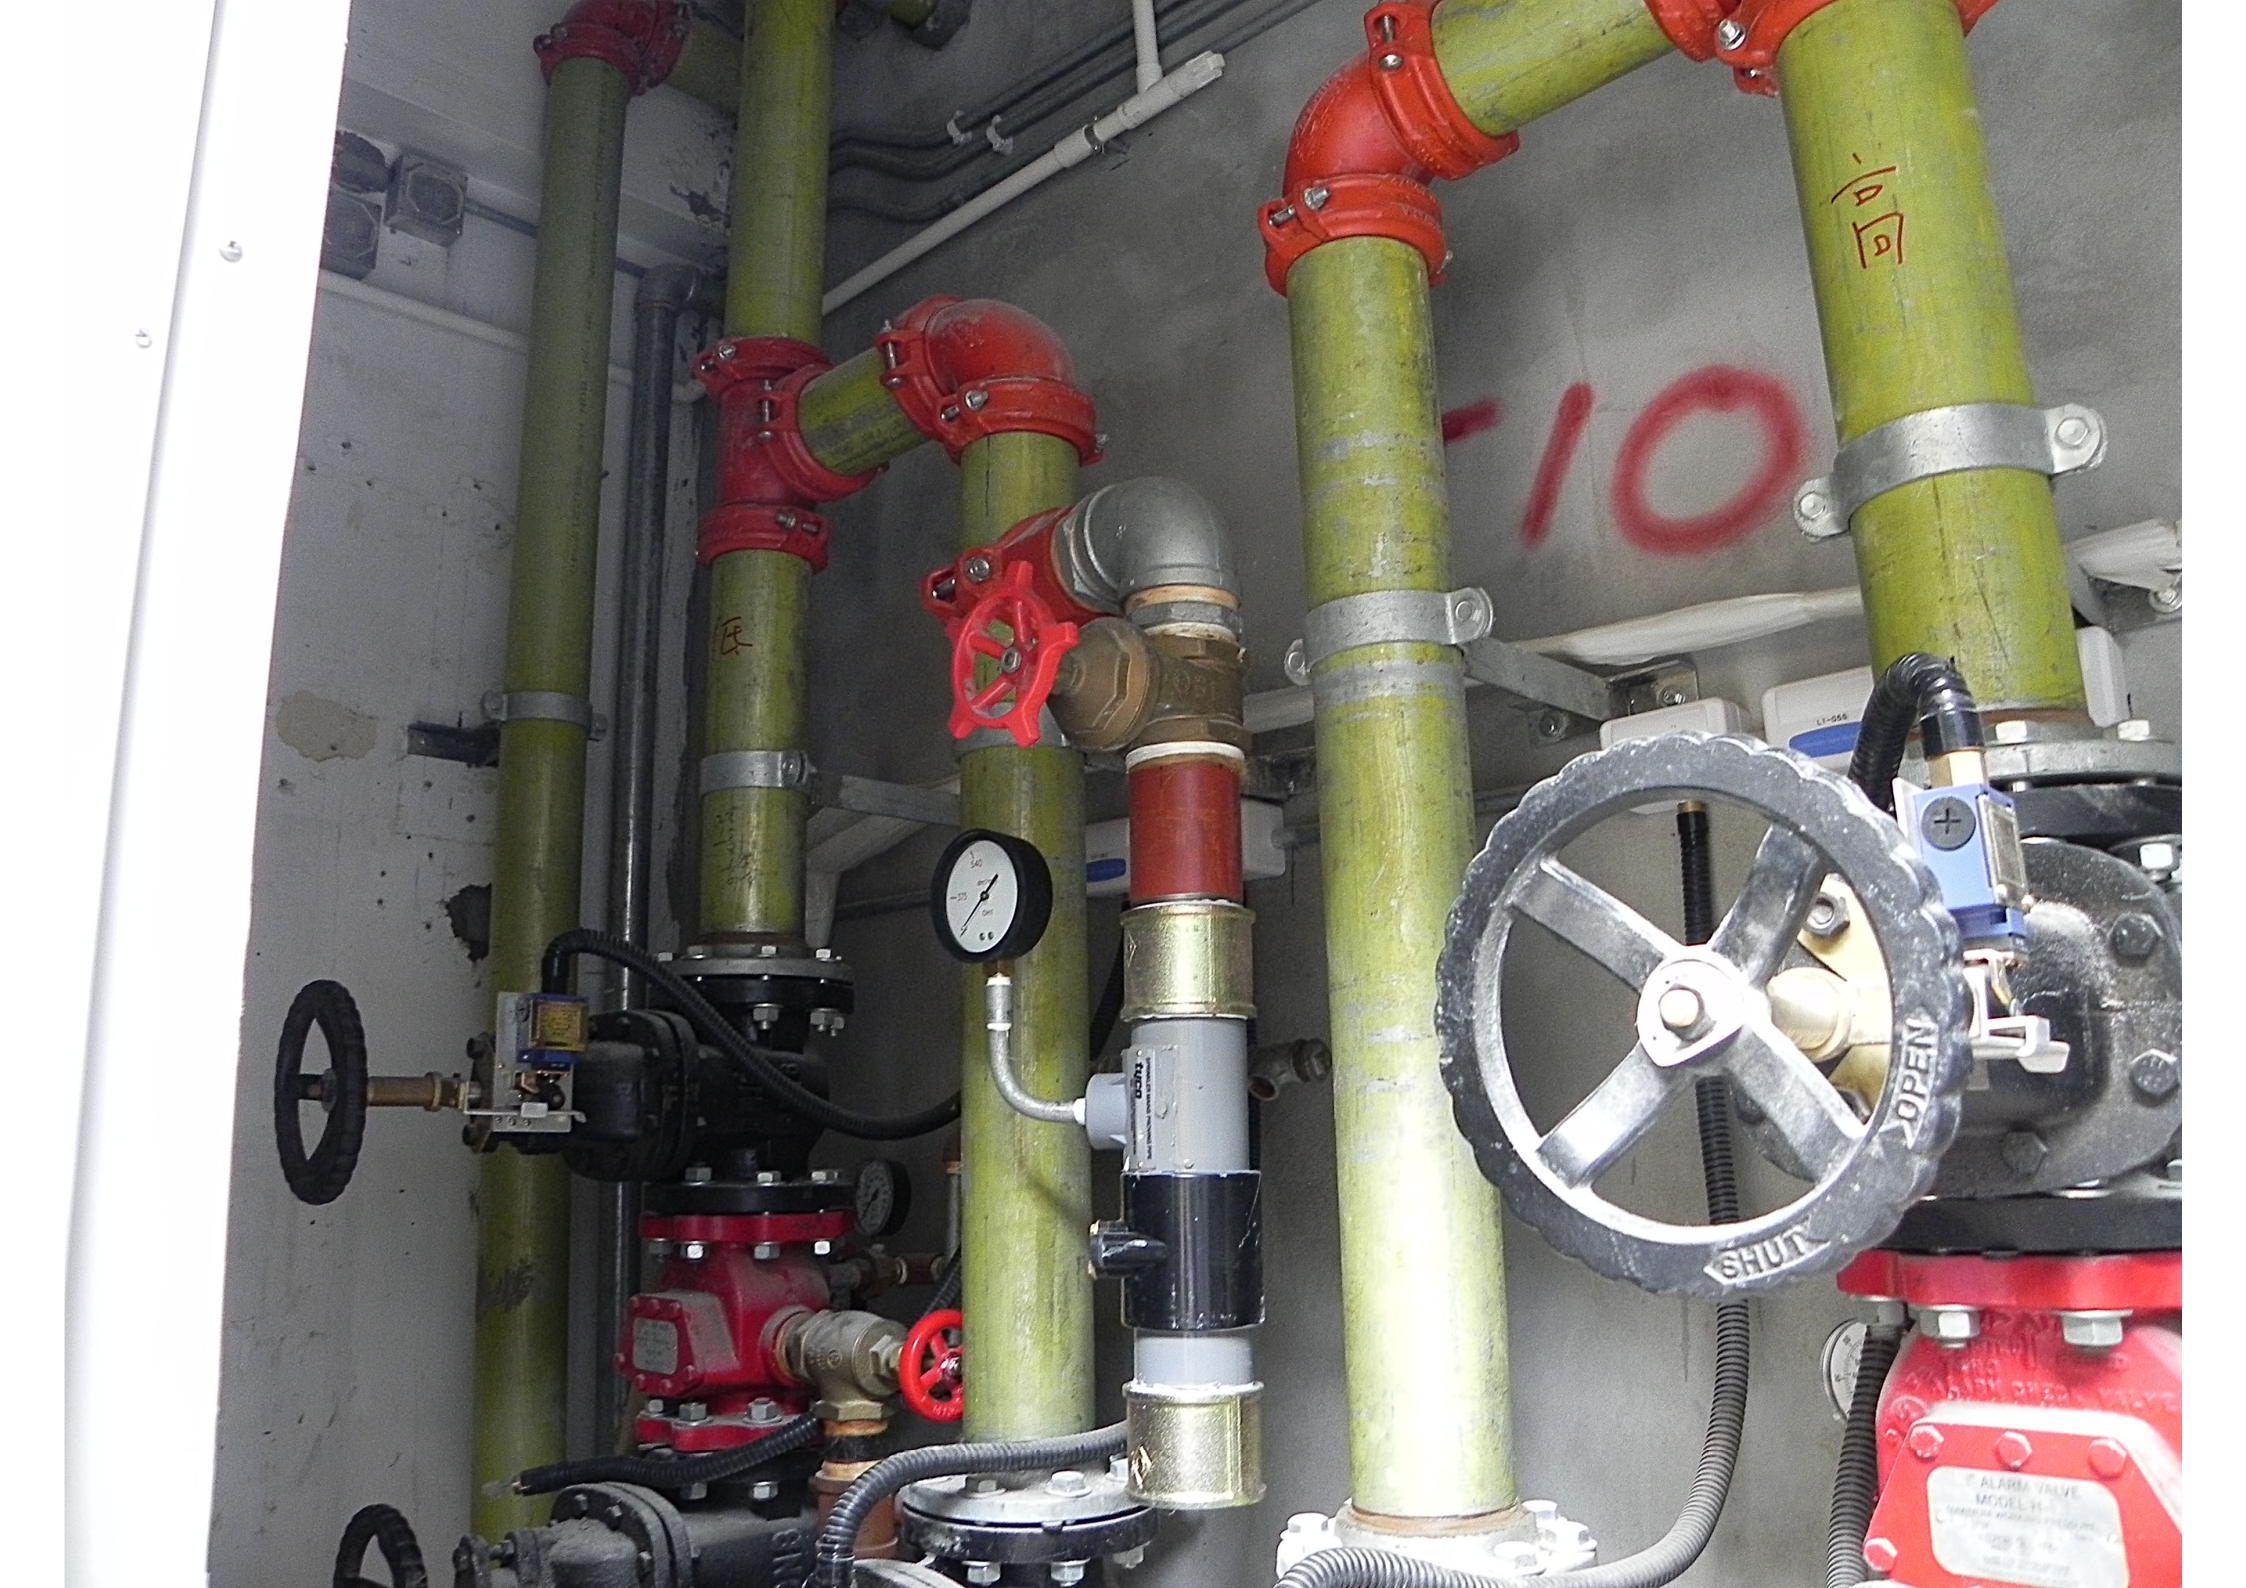



西箱






SPARE SPRINKLER  
CABINET

後備花洒箱





SPARE SPRINKLER  
CABINET  
後備花洒箱

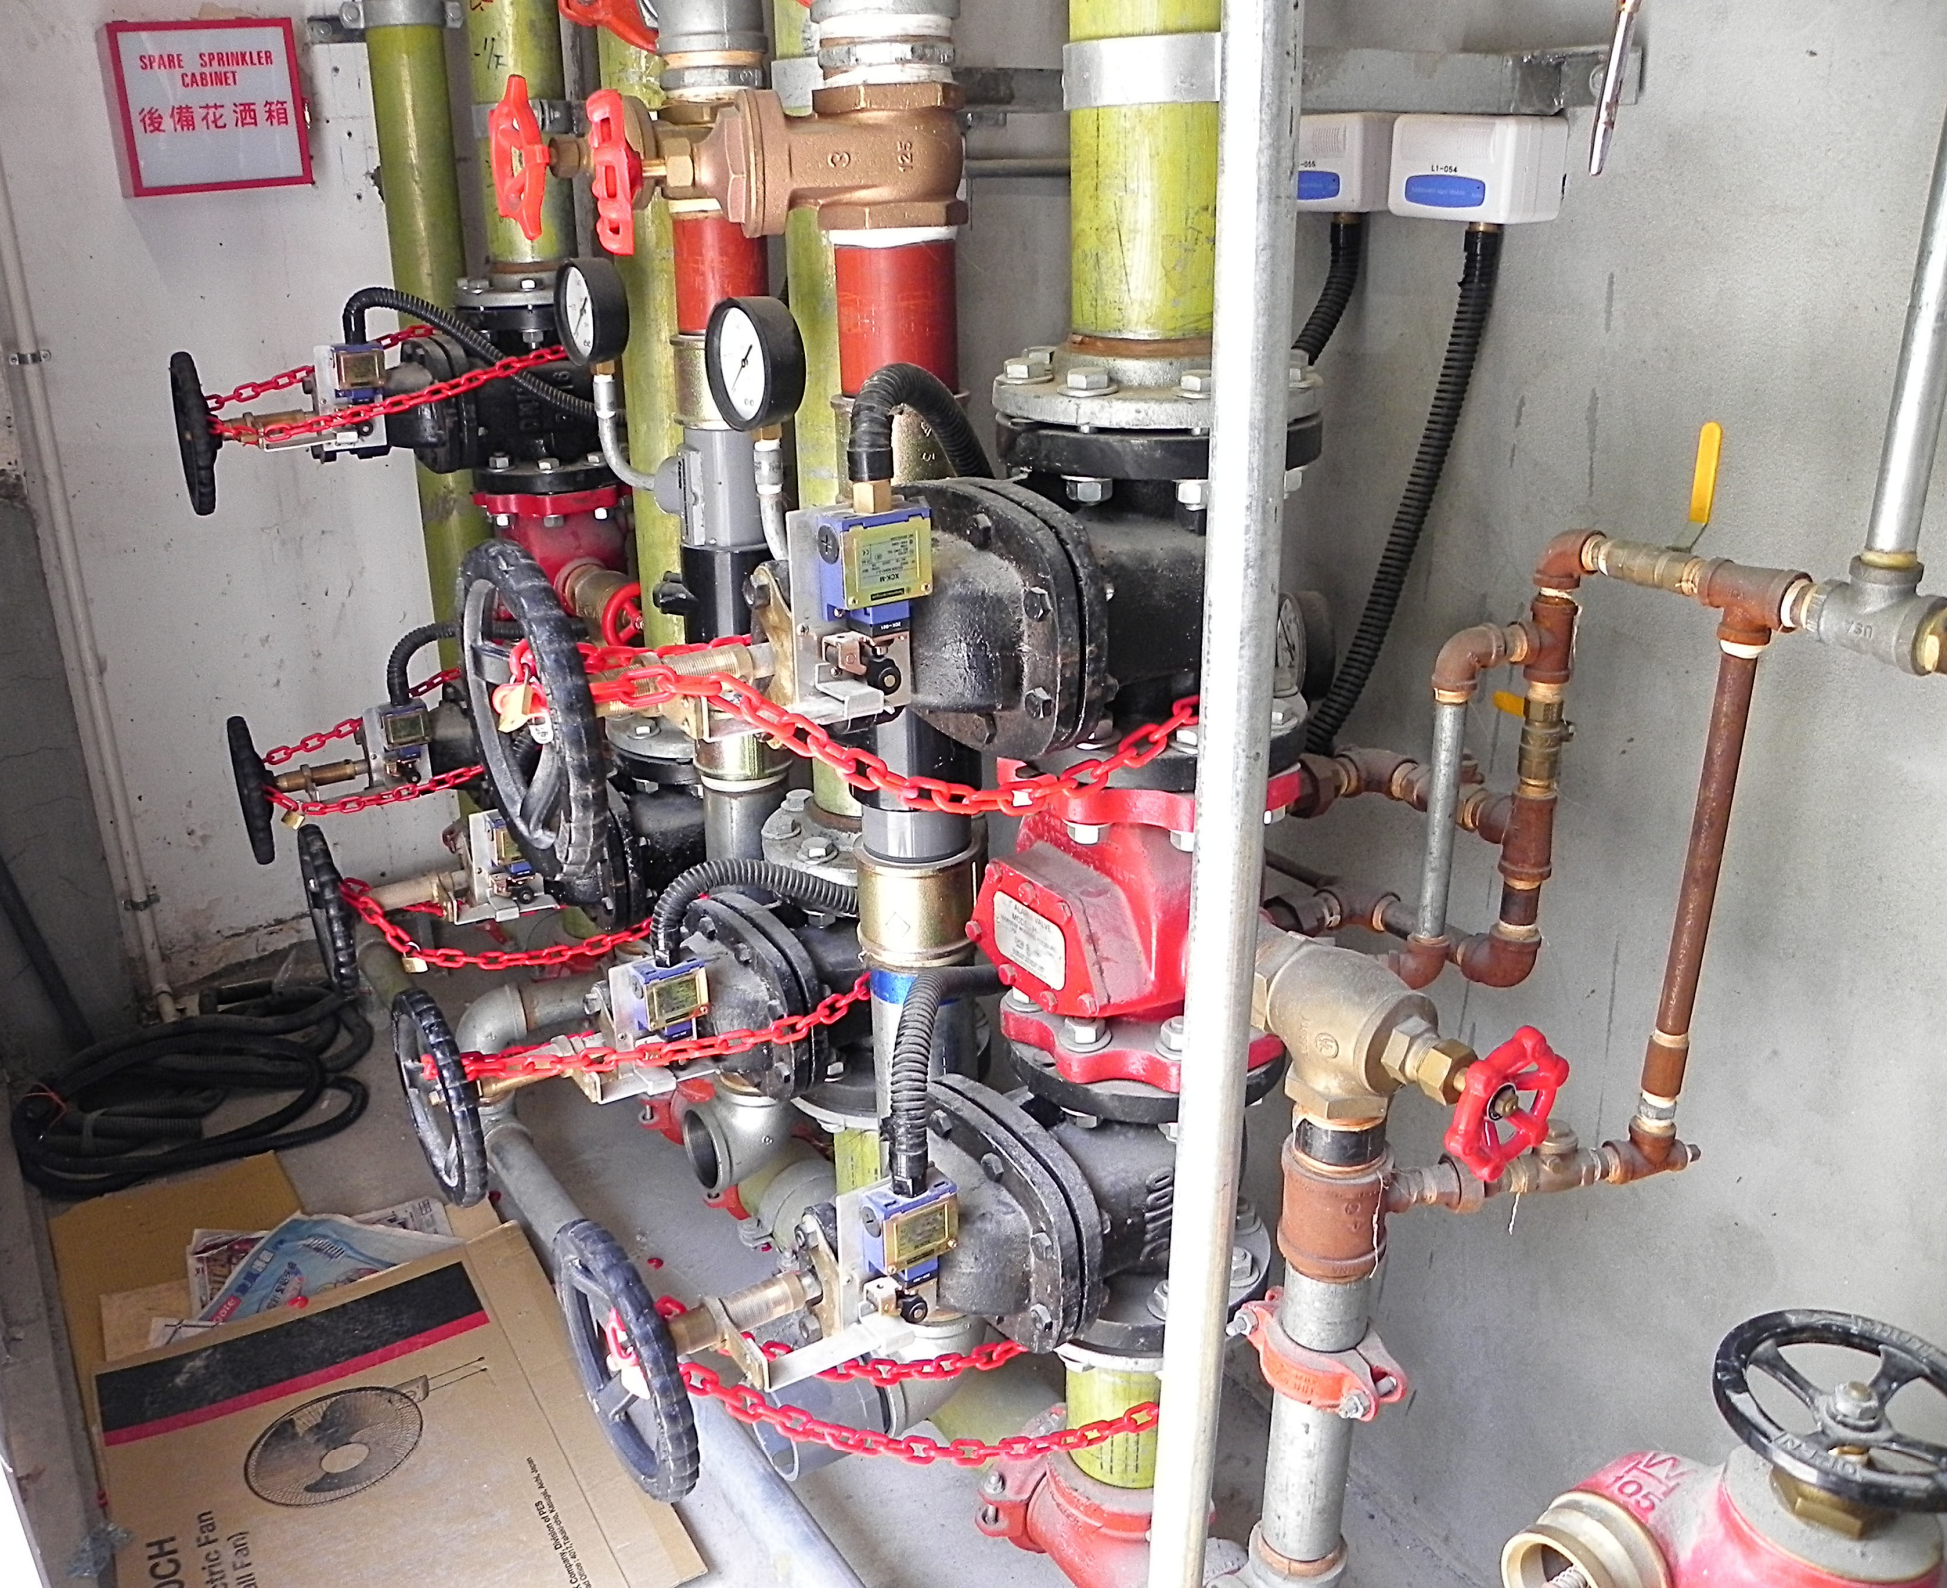

Electric Fan  
All Fan



後備花洒箱

SHIJIANCAIYOU

44  
www.shijiancaiyou.com  
400-888-8888  
138-0000-1234  
138-0000-1234

M40CH  
Electric Fan  
(Wall Fan)  
KDF  
KDF Company, Ltd. (KDF)  
KDF Company, Ltd. (KDF)  
KDF Company, Ltd. (KDF)































T.S.  $\phi 100$

F.S.  $\phi 25$











































